


SERVICE MANUAL

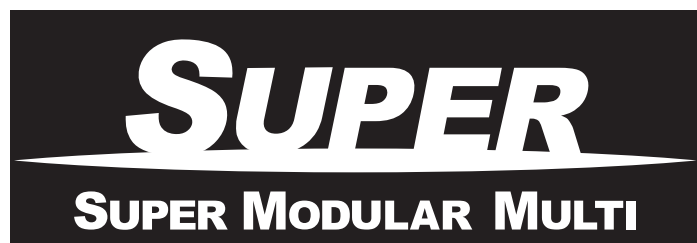

- This manual describes about the model which is installed with the passive filter to the fan driving circuit as the measure against the Europe Harmonic Regulation EN61000-3-12.

The indoor units are same as those of the existing models and they are not especially changed.
For the standard servicing method, refer to the FILE NO. A03-009, A04-008 and A05-004-1.

New models compliance with EMC: IEC61000-3-12

< Outdoor Unit >

Heat Pump Model


MMY-MAP0501HT8-E, MMY-MAP0601HT8-E, MMY-MAP0801HT8-E,
MMY-MAP1001HT8-E, MMY-MAP1201HT8-E

Cooling Only Model

MMY-MAP0501T8-E, MMY-MAP0601T8-E, MMY-MAP0801T8-E,
MMY-MAP1001T8-E, MMY-MAP1201T8-E

Heat Recovery Model

MMY-MAP0802FT8-E, MMY-MAP1002FT8-E, MMY-MAP1202FT8-E

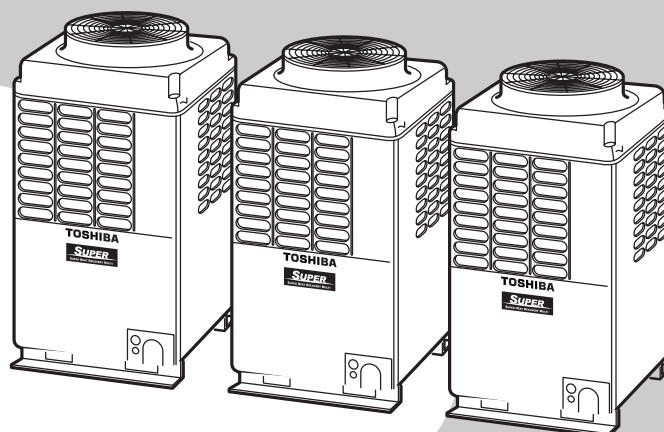

CONTENTS

1. DIFFERENT POINTS OF THE MAIN PARTS	3
2. WIRING DIAGRAM	4
2-1. Outdoor Unit	4
3. TROUBLESHOOTING (Passive Filter Circuit)	7
4. CONFIGURATION OF CONTROL CIRCUIT	9
4-1. Outdoor Unit	9
5. RUNNING CHANGE	10
5-1. Remote Controller Switch	10
5-2. Parts Layout in Outdoor Unit	11
5-3. Refrigerant Piping Systematic Drawing	13
5-4. Refrigerant Recovery When Replacing the Compressor	15
5-5. Replacing Method of Parts	16
5-6. P.C. Board Exchange Procedures (Outdoor Unit)	20
6. DETACHMENTS (Passive Filter Circuit)	21
7. EXPLODED VIEWS AND PARTS LIST	24
7-1. Outdoor Unit (MMY-MAP***HT8-E)	24
Refrigeration Circuit Diagram	28
7-2. Outdoor Unit (MMY-MAP***T8-E)	31
Refrigeration Circuit Diagram	35
7-3. Outdoor Unit (MMY-MAP***FT8-E)	38
Refrigeration Circuit Diagram	42

1. DIFFERENT POINTS OF THE MAIN PARTS

This model is added with the passive filter to the fan driving circuit of the existing model and then Type name is changed. ("-E" is added to the end of the Type name.)

1. Newly changed contents

Addition of passive filter against the harmonic

	Item	Existing model		Model in this time	
		SMMS	SHRM	SMMS	SHRM
1	Power supply P.C. board for fan IPDU	MCC-1439-05		MCC-1439-06 Addition of connector to connect the passive filter	
2	Passive filter	None		Electrolytic capacitor (MCC-1580), Resistance, Diode, Reactor (CH-68)	

2. Contents change of running



1) Reduction in refrigerant amount

Applied models: MMY-MAP0801HT8 (-E), MAP1001HT8 (-E), MAP1201HT8 (-E)
(Only for SMMS heat pump models) Unit: kg

System HP	Existing model	Model in tis time
	SMMS	SMMS
5	—	—
6	—	—
8	12.5	12.0
10	12.5	12.0
12	12.5	12.0

2) Change of oil tank appearance

Applied models: SMMS series, SHRM series

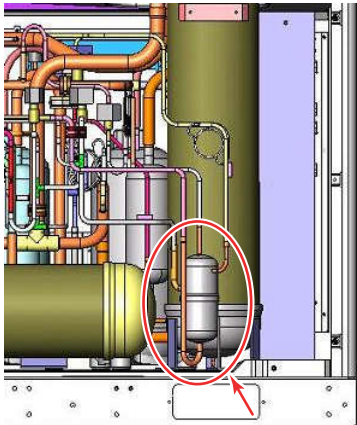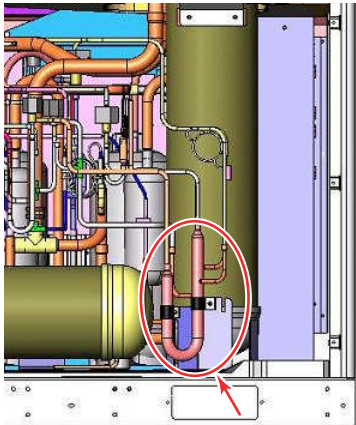
Tank type of Oil tank (past)	Tube type of Oil tank (current)
(Appearance) 	(Appearance) 
(Layout) — Rear view — 	(Layout) — Rear view — 

<Reference: Product Bulletin No.2007-13>

2. WIRING DIAGRAM

2-1. Outdoor Unit

Model: MMY-MAP0501HT8-E, MMY-MAP0601HT8-E, MMY-MAP0801HT8-E,
MMY-MAP1001HT8-E, MMY-MAP1201HT8-E

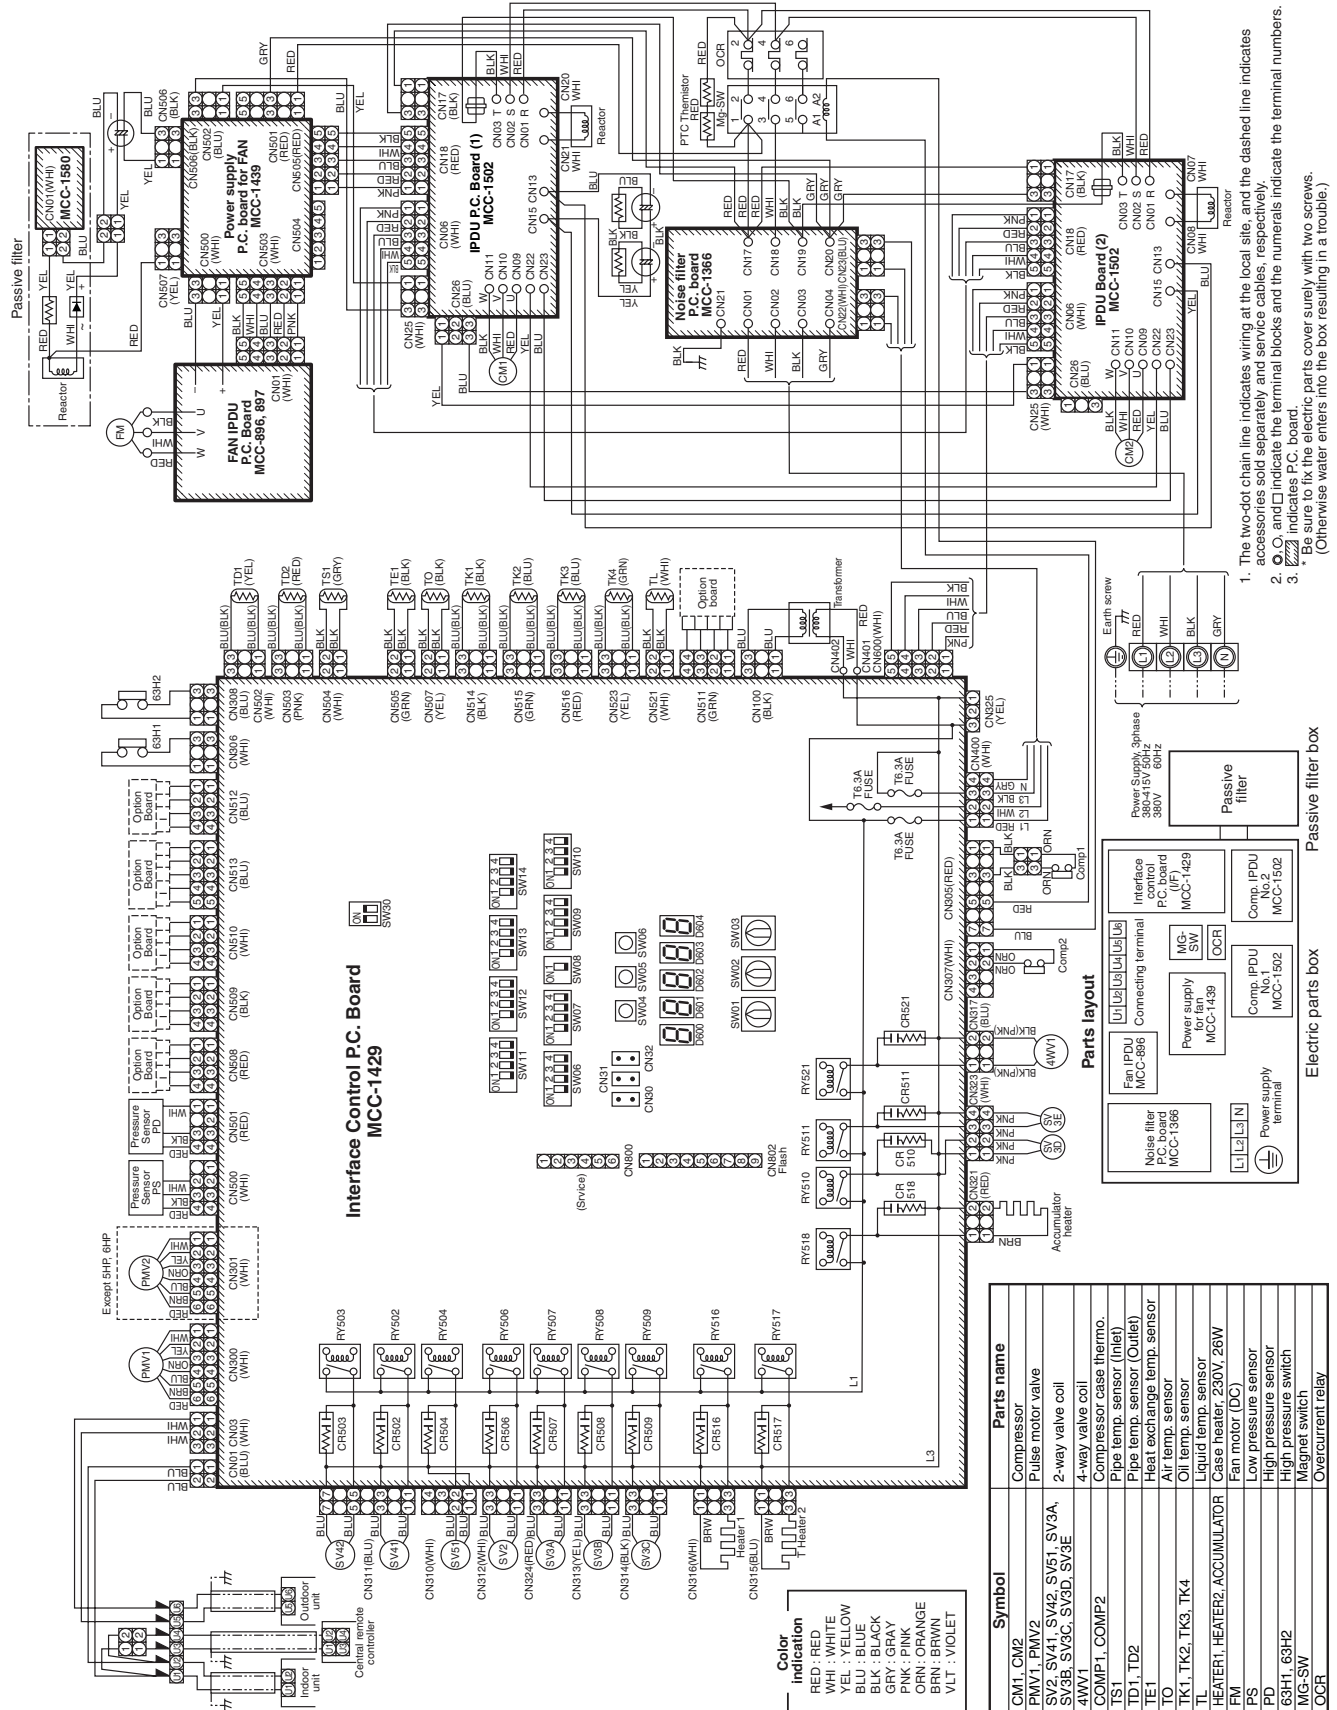

Color indication

RED	: RED
WHI	: WHITE
YEL	: YELLOW
BLU	: BLUE
BLK	: BLACK
GRY	: GRAY
PNK	: PINK
ORN	: ORANGE
BRN	: BROWN
VLT	: VIOLET

Parts name

CM1, CM2	Compressor
PM1, PM2	Pulse motor valve
SV2, SV41, SV42, SV51, SV3A, SV3B, SV3C, SV3D, SV3E	2-way valve coil
4WV1	4-way valve coil
COMP1, COMP2	Compressor case thermo.
TS1	Pipe temp. sensor (Inlet)
TD1, TD2	Pipe temp. sensor (Outlet)
TE1	Heat exchange temp. sensor
TO	Air temp. sensor
TK1, TK2, TK3, TK4	Oil temp. sensor
TL	Liquid temp. sensor
HEATER1, HEATER2, ACCUMULATOR	Case heater, 230V, 28W
FM	Fan motor (DC)
PS	Low pressure sensor
PD	High pressure sensor
63H1, 63H2	High pressure switch
MG-SW	Magnet switch
MCR	Overcurrent relay

Parts layout

Interface Control P.C. Board MCC-1429

Power supply for fan MCC-1439

Noise filter P.C. board MCC-1366

Fan IPDU P.C. board MCC-896

Comp. IPDU No.1 MCC-1502

Comp. IPDU No.2 MCC-1502

Interface control P.C. board MCC-1429

MG-SW

OCR

Passive filter

Electric parts box

Passive filter box

Power Supply 380-415V 50Hz

Earth screw

Reactor 2

Reactor 1

Reactor 3

Reactor 4

Reactor 5

Reactor 6

Reactor 7

Reactor 8

Reactor 9

Reactor 10

Reactor 11

Reactor 12

Reactor 13

Reactor 14

Reactor 15

Reactor 16

Reactor 17

Reactor 18

Reactor 19

Reactor 20

Reactor 21

Reactor 22

Reactor 23

Reactor 24

Reactor 25

Reactor 26

Reactor 27

Reactor 28

Reactor 29

Reactor 30

Reactor 31

Reactor 32

Reactor 33

Reactor 34

Reactor 35

Reactor 36

Reactor 37

Reactor 38

Reactor 39

Reactor 40

Reactor 41

Reactor 42

Reactor 43

Reactor 44

Reactor 45

Reactor 46

Reactor 47

Reactor 48

Reactor 49

Reactor 50

Reactor 51

Reactor 52

Reactor 53

Reactor 54

Reactor 55

Reactor 56

Reactor 57

Reactor 58

Reactor 59

Reactor 60

Reactor 61

Reactor 62

Reactor 63

Reactor 64

Reactor 65

Reactor 66

Reactor 67

Reactor 68

Reactor 69

Reactor 70

Reactor 71

Reactor 72

Reactor 73

Reactor 74

Reactor 75

Reactor 76

Reactor 77

Reactor 78

Reactor 79

Reactor 80

Reactor 81

Reactor 82

Reactor 83

Reactor 84

Reactor 85

Reactor 86

Reactor 87

Reactor 88

Reactor 89

Reactor 90

Reactor 91

Reactor 92

Reactor 93

Reactor 94

Reactor 95

Reactor 96

Reactor 97

Reactor 98

Reactor 99

Reactor 100

Reactor 101

Reactor 102

Reactor 103

Reactor 104

Reactor 105

Reactor 106

Reactor 107

Reactor 108

Reactor 109

Reactor 110

Reactor 111

Reactor 112

Reactor 113

Reactor 114

Reactor 115

Reactor 116

Reactor 117

Reactor 118

Reactor 119

Reactor 120

Reactor 121

Reactor 122

Reactor 123

Reactor 124

Reactor 125

Reactor 126

Reactor 127

Reactor 128

Reactor 129

Reactor 130

Reactor 131

Reactor 132

Reactor 133

Reactor 134

Reactor 135

Reactor 136

Reactor 137

Reactor 138

Reactor 139

Reactor 140

Reactor 141

Reactor 142

Reactor 143

Reactor 144

Reactor 145

Reactor 146

Reactor 147

Reactor 148

Reactor 149

Reactor 150

Reactor 151

Reactor 152

Reactor 153

Reactor 154

Reactor 155

Reactor 156

Reactor 157

Reactor 158

Reactor 159

Reactor 160

Reactor 161

Reactor 162

Reactor 163

Reactor 164

Reactor 165

Reactor 166

Reactor 167

Reactor 168

Reactor 169

Reactor 170

Reactor 171

Reactor 172

Reactor 173

Reactor 174

Reactor 175

Reactor 176

Reactor 177

Reactor 178

Reactor 179

Reactor 180

Reactor 181

Reactor 182

Reactor 183

Reactor 184

Reactor 185

Reactor 186

Reactor 187

Reactor 188

Reactor 189

Reactor 190

Reactor 191

Reactor 192

Reactor 193

Reactor 194

Reactor 195

Reactor 196

Reactor 197

Reactor 198

Reactor 199

Reactor 200

Reactor 201

Reactor 202

Reactor 203

Reactor 204

Reactor 205

Reactor 206

Reactor 207

Reactor 208

Reactor 209

Reactor 210

Reactor 211

Reactor 212

Reactor 213

Reactor 214

Reactor 215

Reactor 216

Reactor 217

Reactor 218

Reactor 219

Reactor 220

Reactor 221

Reactor 222

Reactor 223

Reactor 224

Reactor 225

Reactor 226

Reactor 227

Reactor 228

Reactor 229

Reactor 230

Reactor 231

Reactor 232

Reactor 233

Reactor 234

Reactor 235

Reactor 236

Reactor 237

Reactor 238

Reactor 239

Reactor 240

Reactor 241

Reactor 242

Reactor 243

Reactor 244

Reactor 245

Reactor 246

Reactor 247

Reactor 248

Reactor 249

Reactor 250

Reactor 251

Reactor 252

Reactor 253

Reactor 254

Reactor 255


Reactor 256

Reactor 257

Reactor 258

Reactor

Model: MMY-MAP0802FT8-E, MMY-MAP1002FT8-E, MMY-MAP1202FT8-E

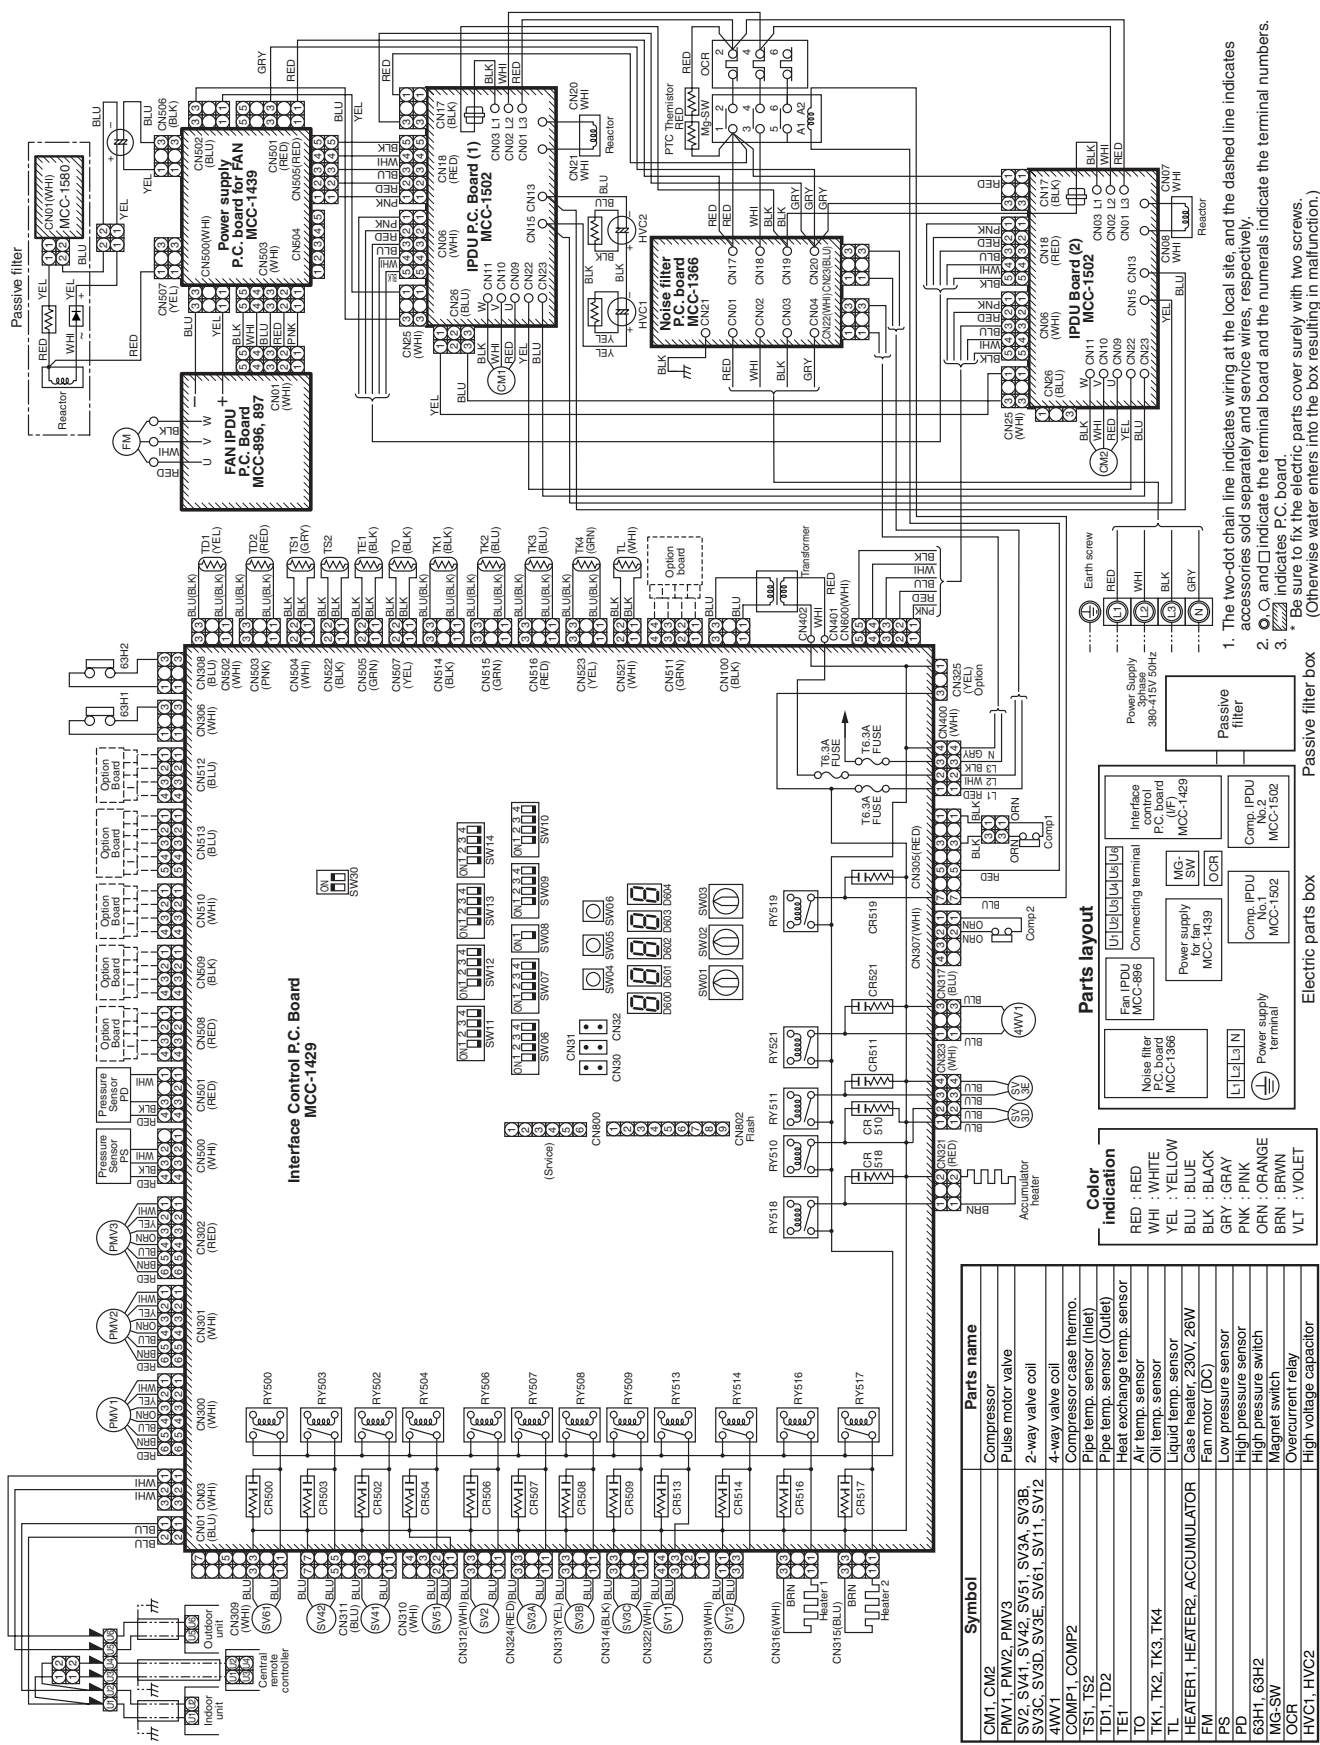

3. TROUBLESHOOTING (Passive Filter Circuit)



■ Diagnosis procedure for each check code

<SMMS Series (A03-009, A04-008) >

Check code name	Check code name	Cause of operation
[L29] / [CF] (d07 / AI-NET)	IPDU quantity error	1. Incorrect model setup in service for I/F P.C. board 2. Communication error between IPDU, fan IPDU and I/F 3. IPDU, fan IPDU, I/F P.C. board error 4. Passive filter error

Sub-code:

01: IPDU1 error
 02: IPDU2 error
 03: IPDU1, 2 error
 04: Fan IPDU error
 05: IPDU1, fan IPDU error
 06: IPDU2, fan IPDU error
 07: All IPDU error, Disconnection of communication line between IPDU-I/F P.C. board,
 "I/F control P.C. board" error, "Power supply P.C. board for FAN" error, "Passive filter" error

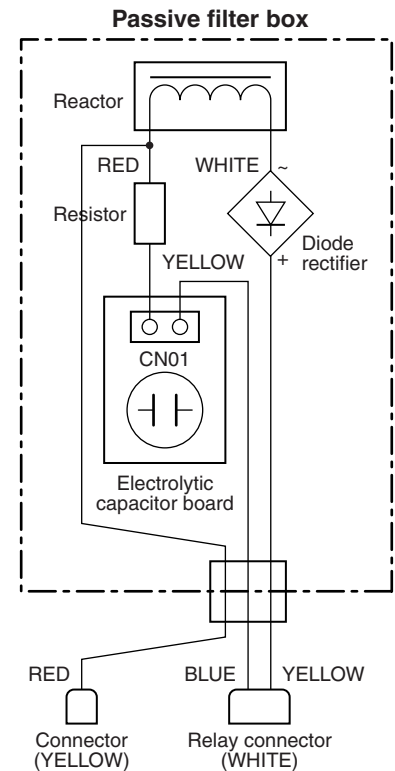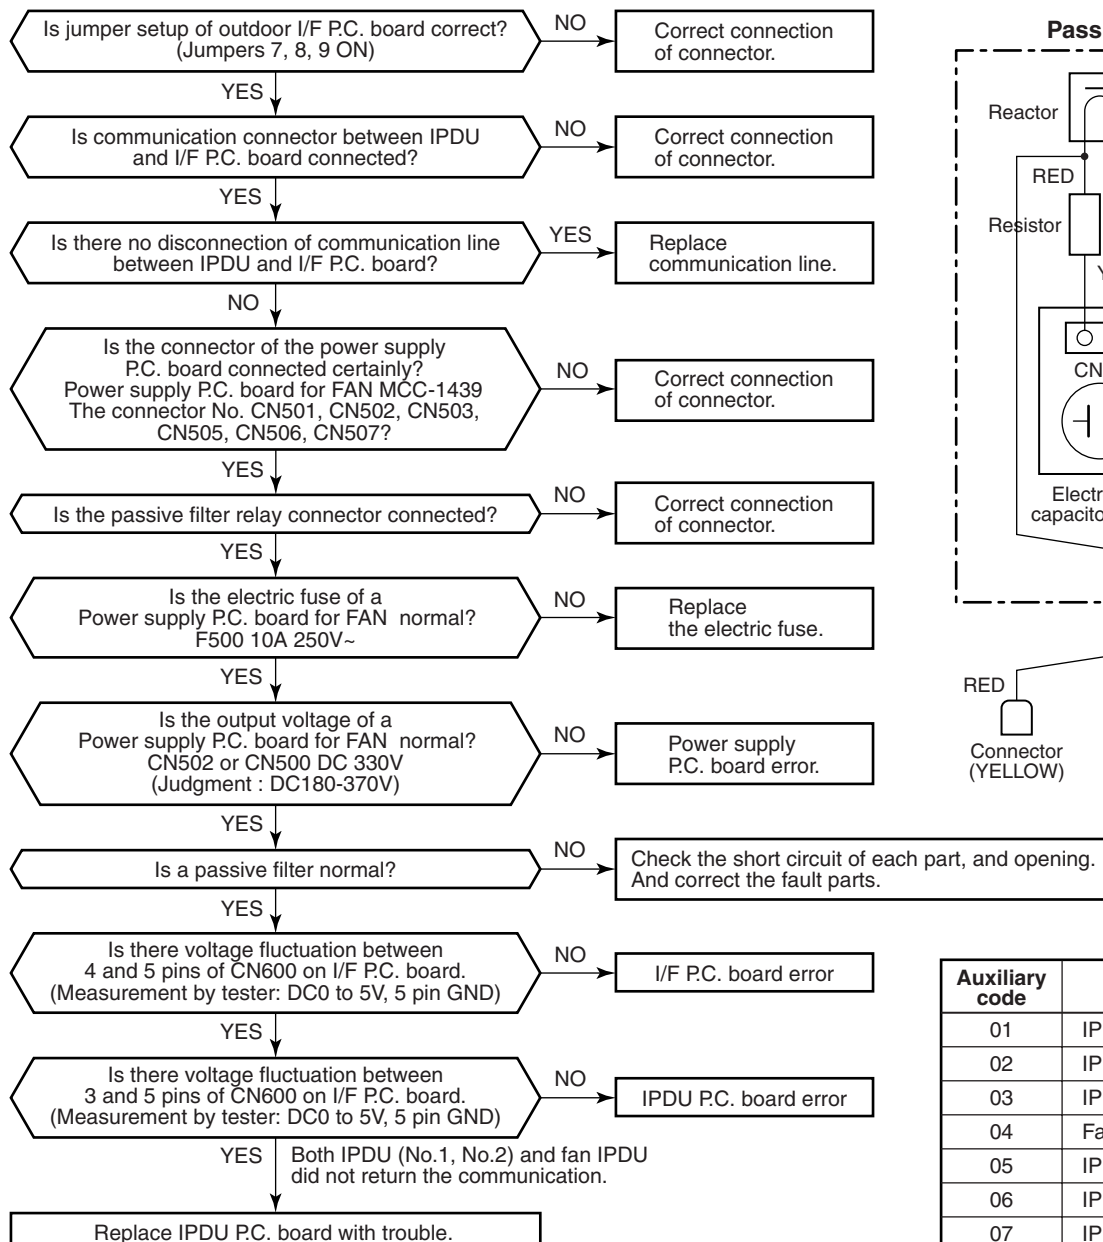

Auxiliary code	P.C. board to be replaced
01	IPDU 1
02	IPDU 2
03	IPDU 1, 2
04	Fan IPDU
05	IPDU 1, fan IPDU
06	IPDU 2, fan IPDU
07	IPDU 1, 2, fan IPDU, I/F

<SHRM Series (A05-004-1) >

Check code name	Check code name	Cause of operation
[L29] / [CF] (d07 / AI-NET)	IPDU quantity error	1. Incorrect model setup in service for I/F P.C. board 2. Communication error between IPDU, fan IPDU and I/F 3. IPDU, fan IPDU, I/F P.C. board error 4. Passive filter error

Sub-code:

01: IPDU1 error

02: IPDU2 error



03: IPDU1, 2 error

04: Fan IPDU error

05: IPDU1, fan IPDU error

06: IPDU2, fan IPDU error

07: All IPDU error, Disconnection of communication line between IPDU-I/F P.C. board,
 "I/F control P.C. board" error, "Power supply P.C. board for FAN" error, "Passive filter" error

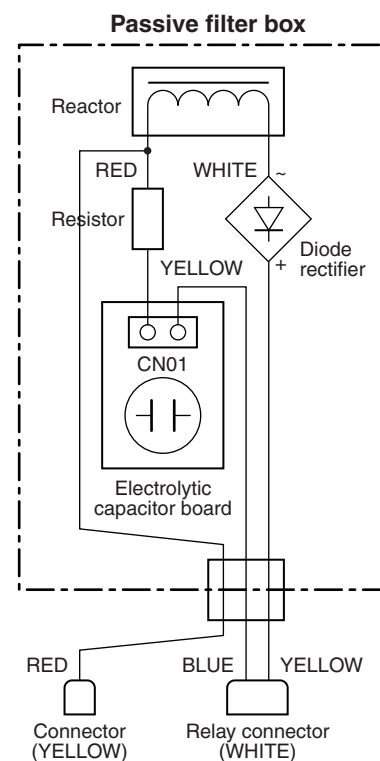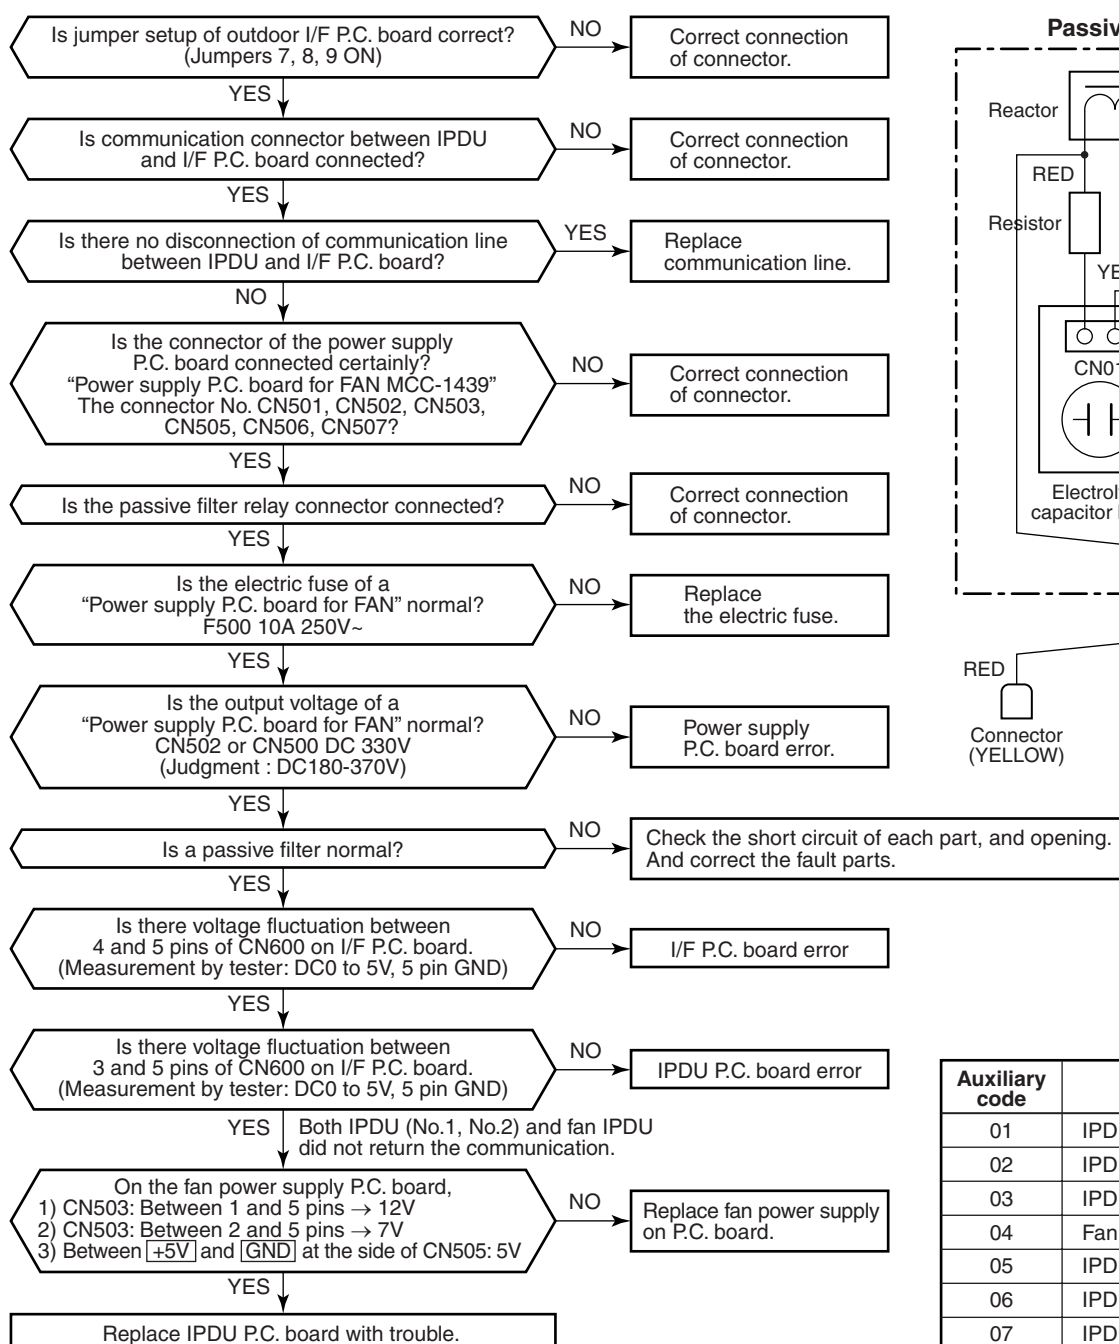


Auxiliary code	P.C. board to be replaced
01	IPDU 1
02	IPDU 2
03	IPDU 1, 2
04	Fan IPDU
05	IPDU 1, fan IPDU
06	IPDU 2, fan IPDU
07	IPDU 1, 2, fan IPDU, I/F

4. CONFIGURATION OF CONTROL CIRCUIT



4-1. Outdoor Unit

Power P.C. board for fan (MCC-1439)

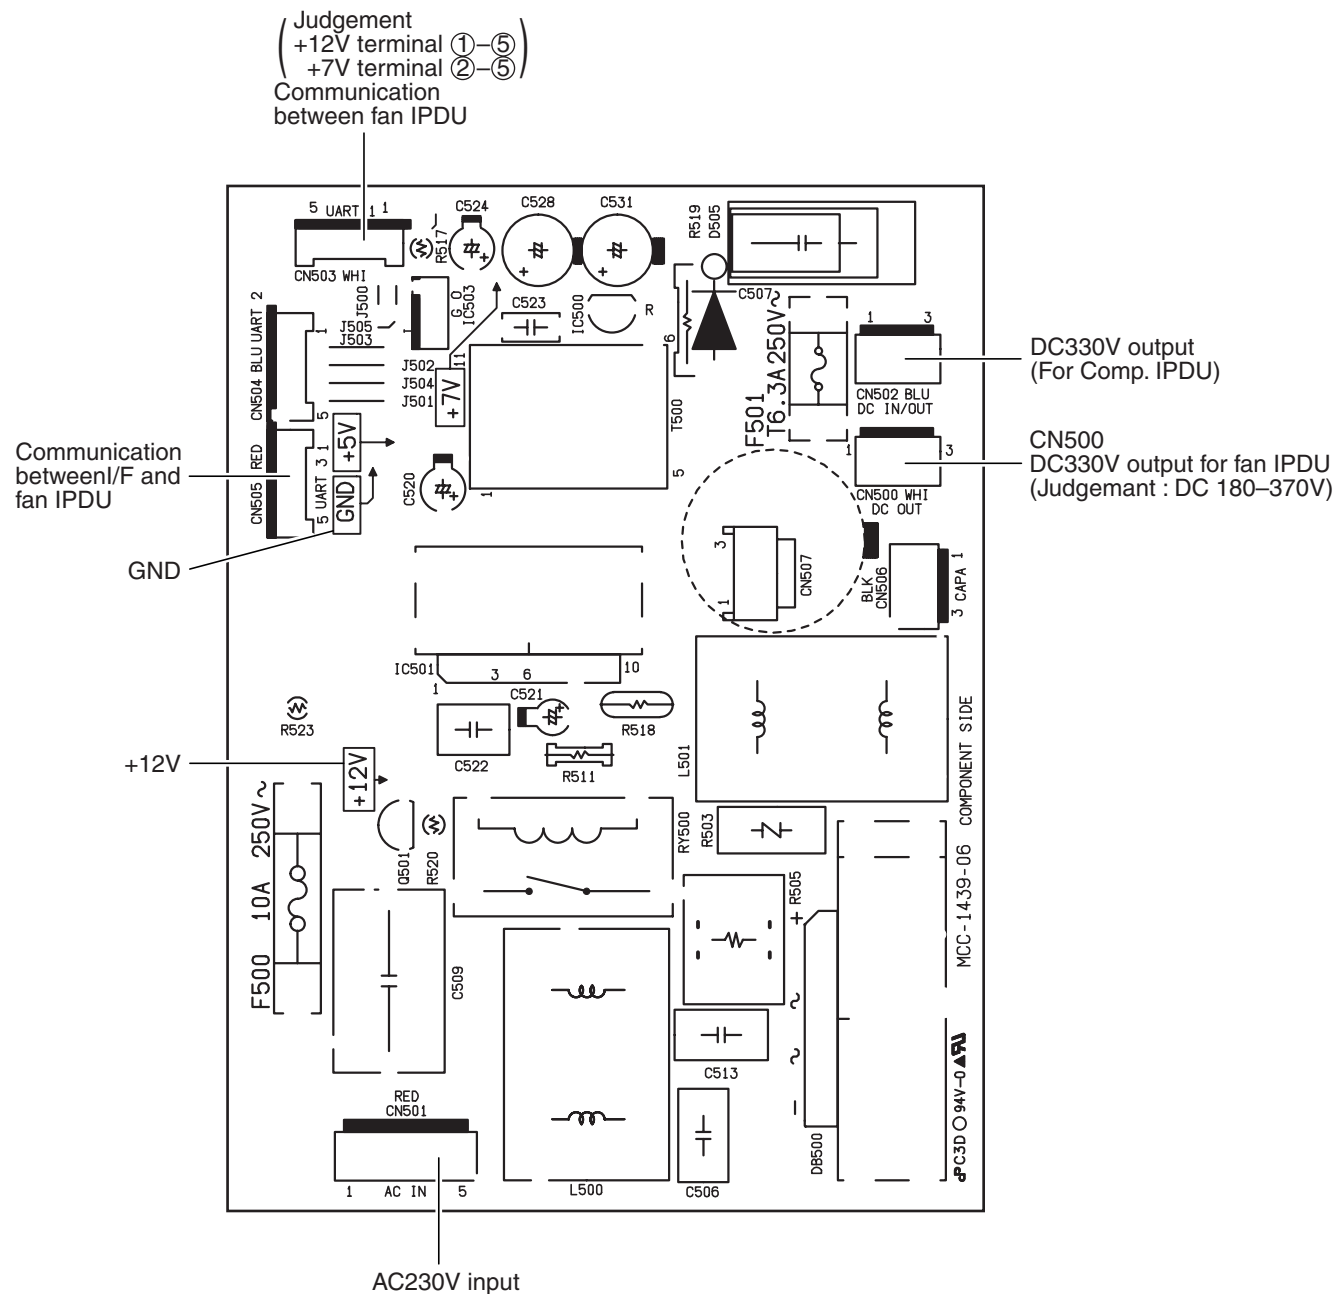

5. RUNNING CHANGE

5-1. Remote Controller Switch

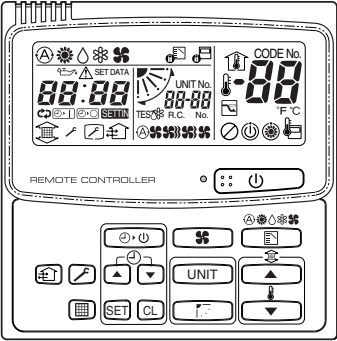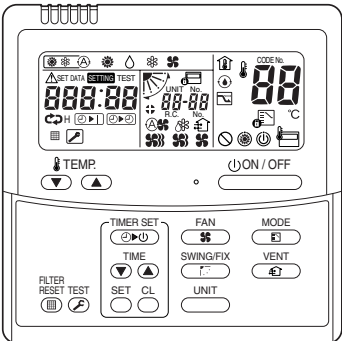
Name	Wired remote controller	Wired remote controller
Appearance		
Model name	RBC-AMT21E	RBC-AMT31E
Type		


NOTE

The model name of the Wired remote controller is changed to RBC-AMT31E and some illustrations are changed. The expression method is a little changed but functionally is not changed.
Explanation for detailed operation method, etc. are omitted.

5-2. Parts Layout in Outdoor Unit

<SMMS Series (A03-009, A04-008) >

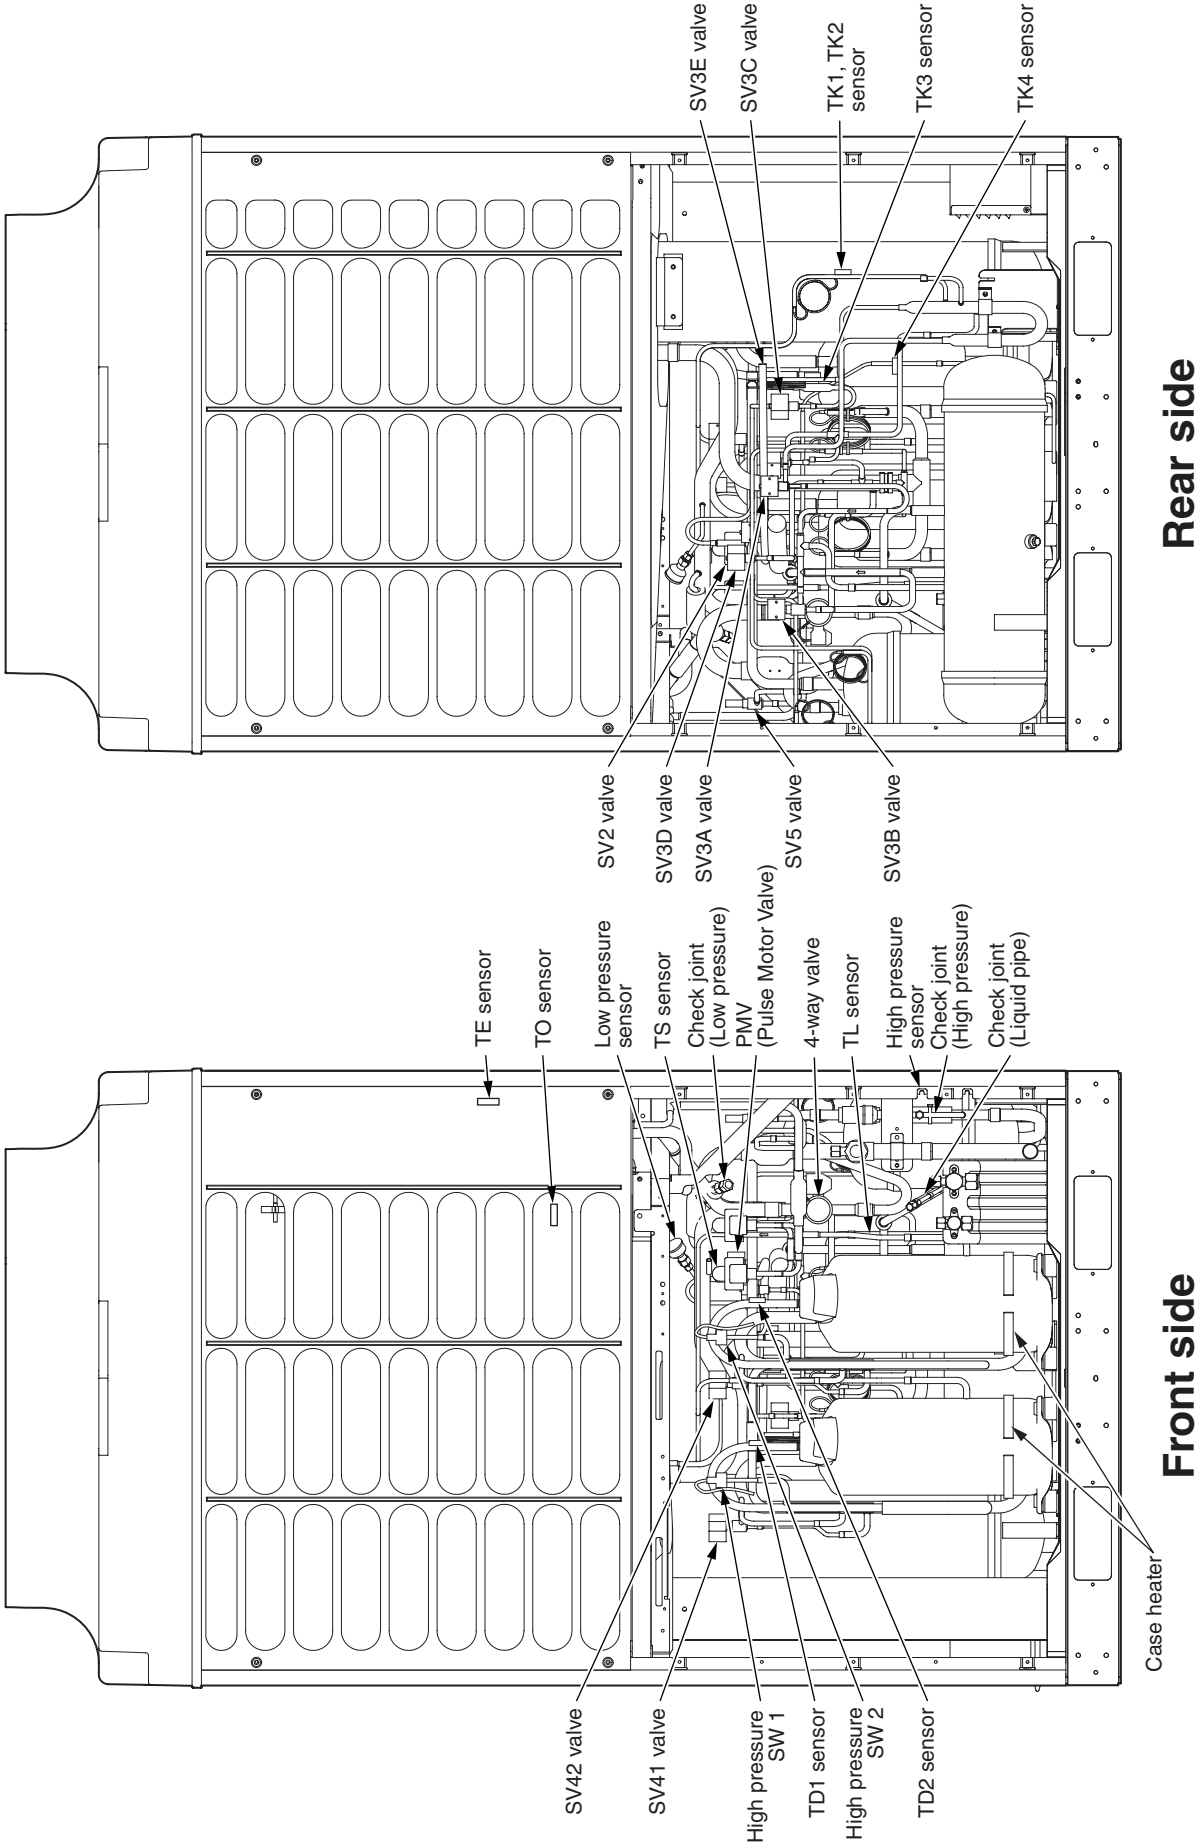


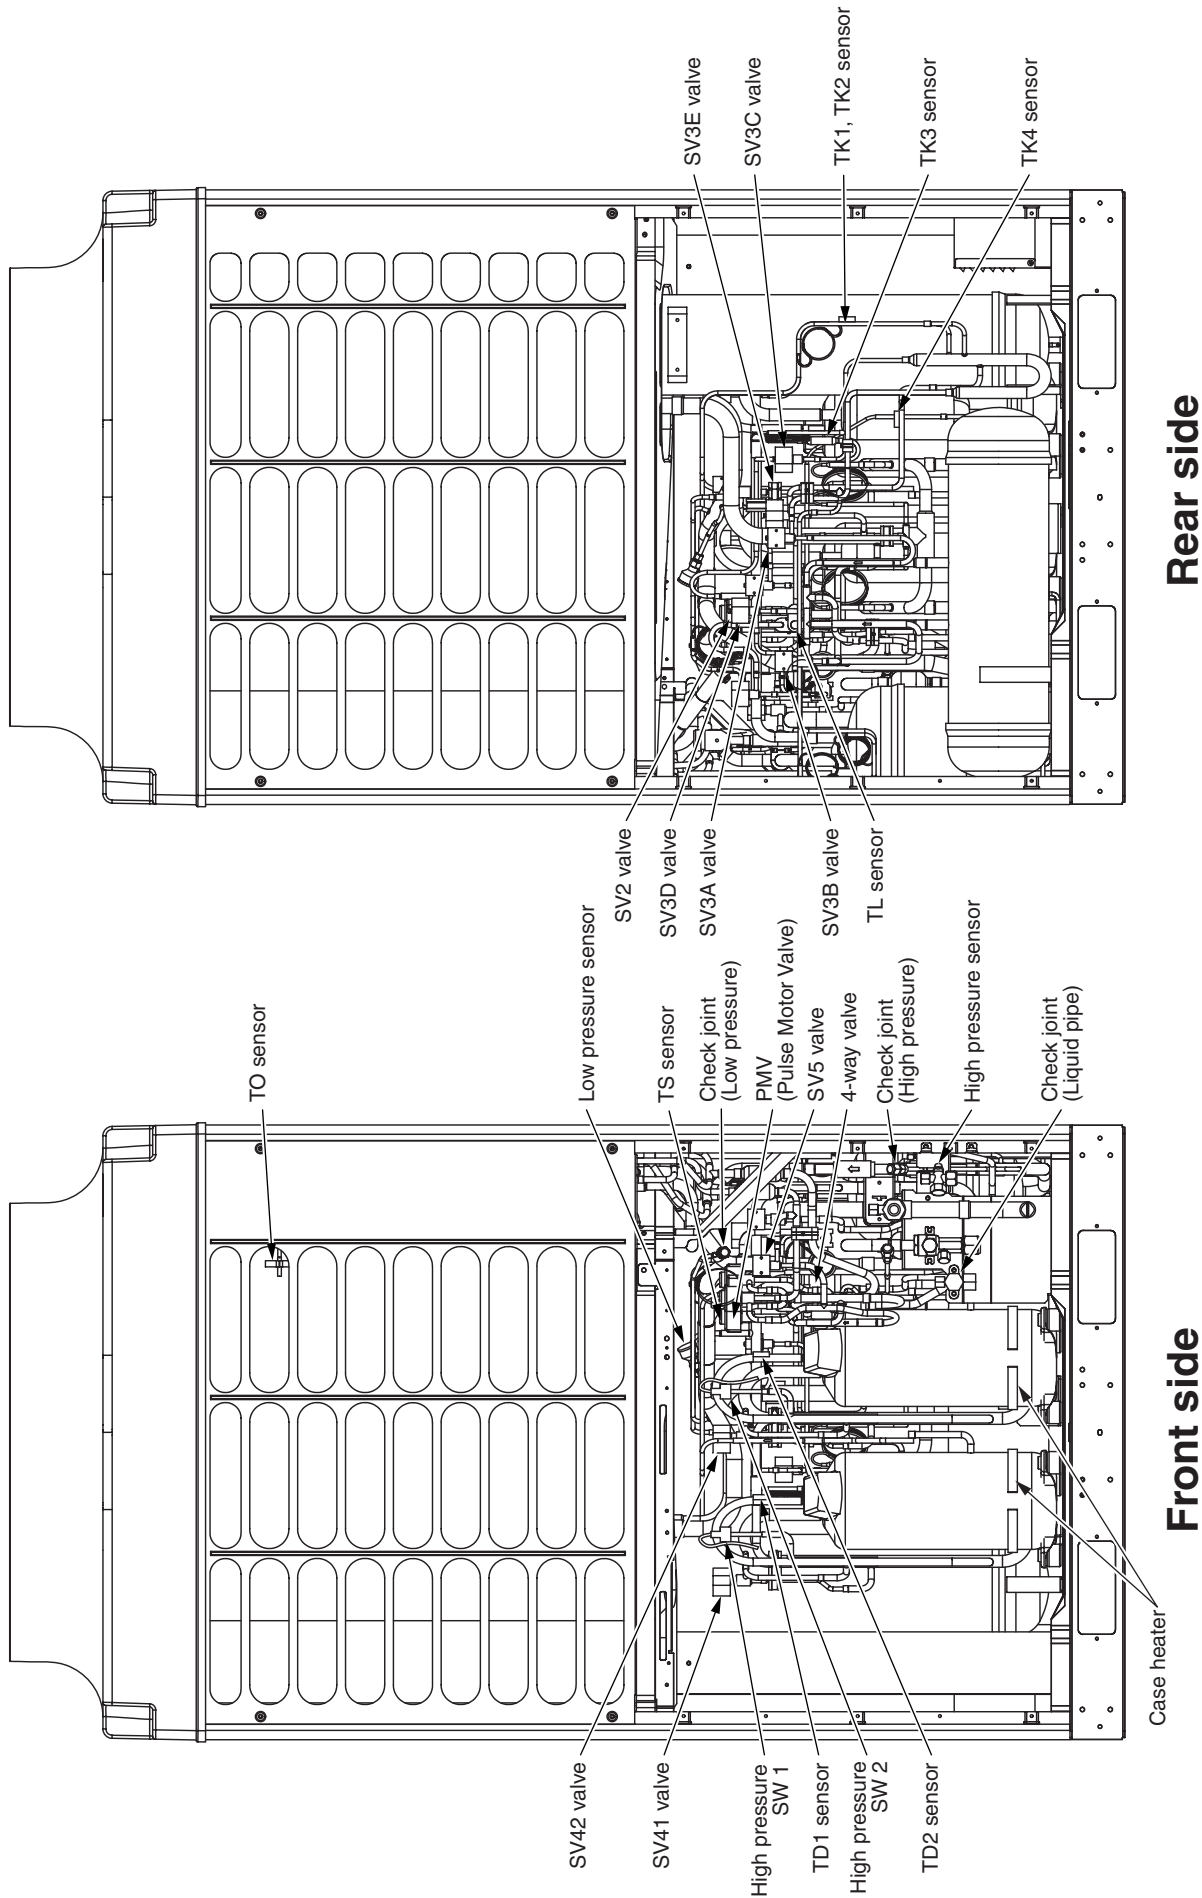

5-3. Refrigerant Piping Systematic Drawing


■ Inverter unit (5, 6, 8, 10, 12HP)

Model: MMY-MAP0501HT8-E (T8-E), MMY-MAP0601HT8-E (T8-E), MMY-MAP0801HT8-E (T8-E), MMY-MAP1001HT8-E (T8-E), MMY-MAP1201HT8-E (T8-E)

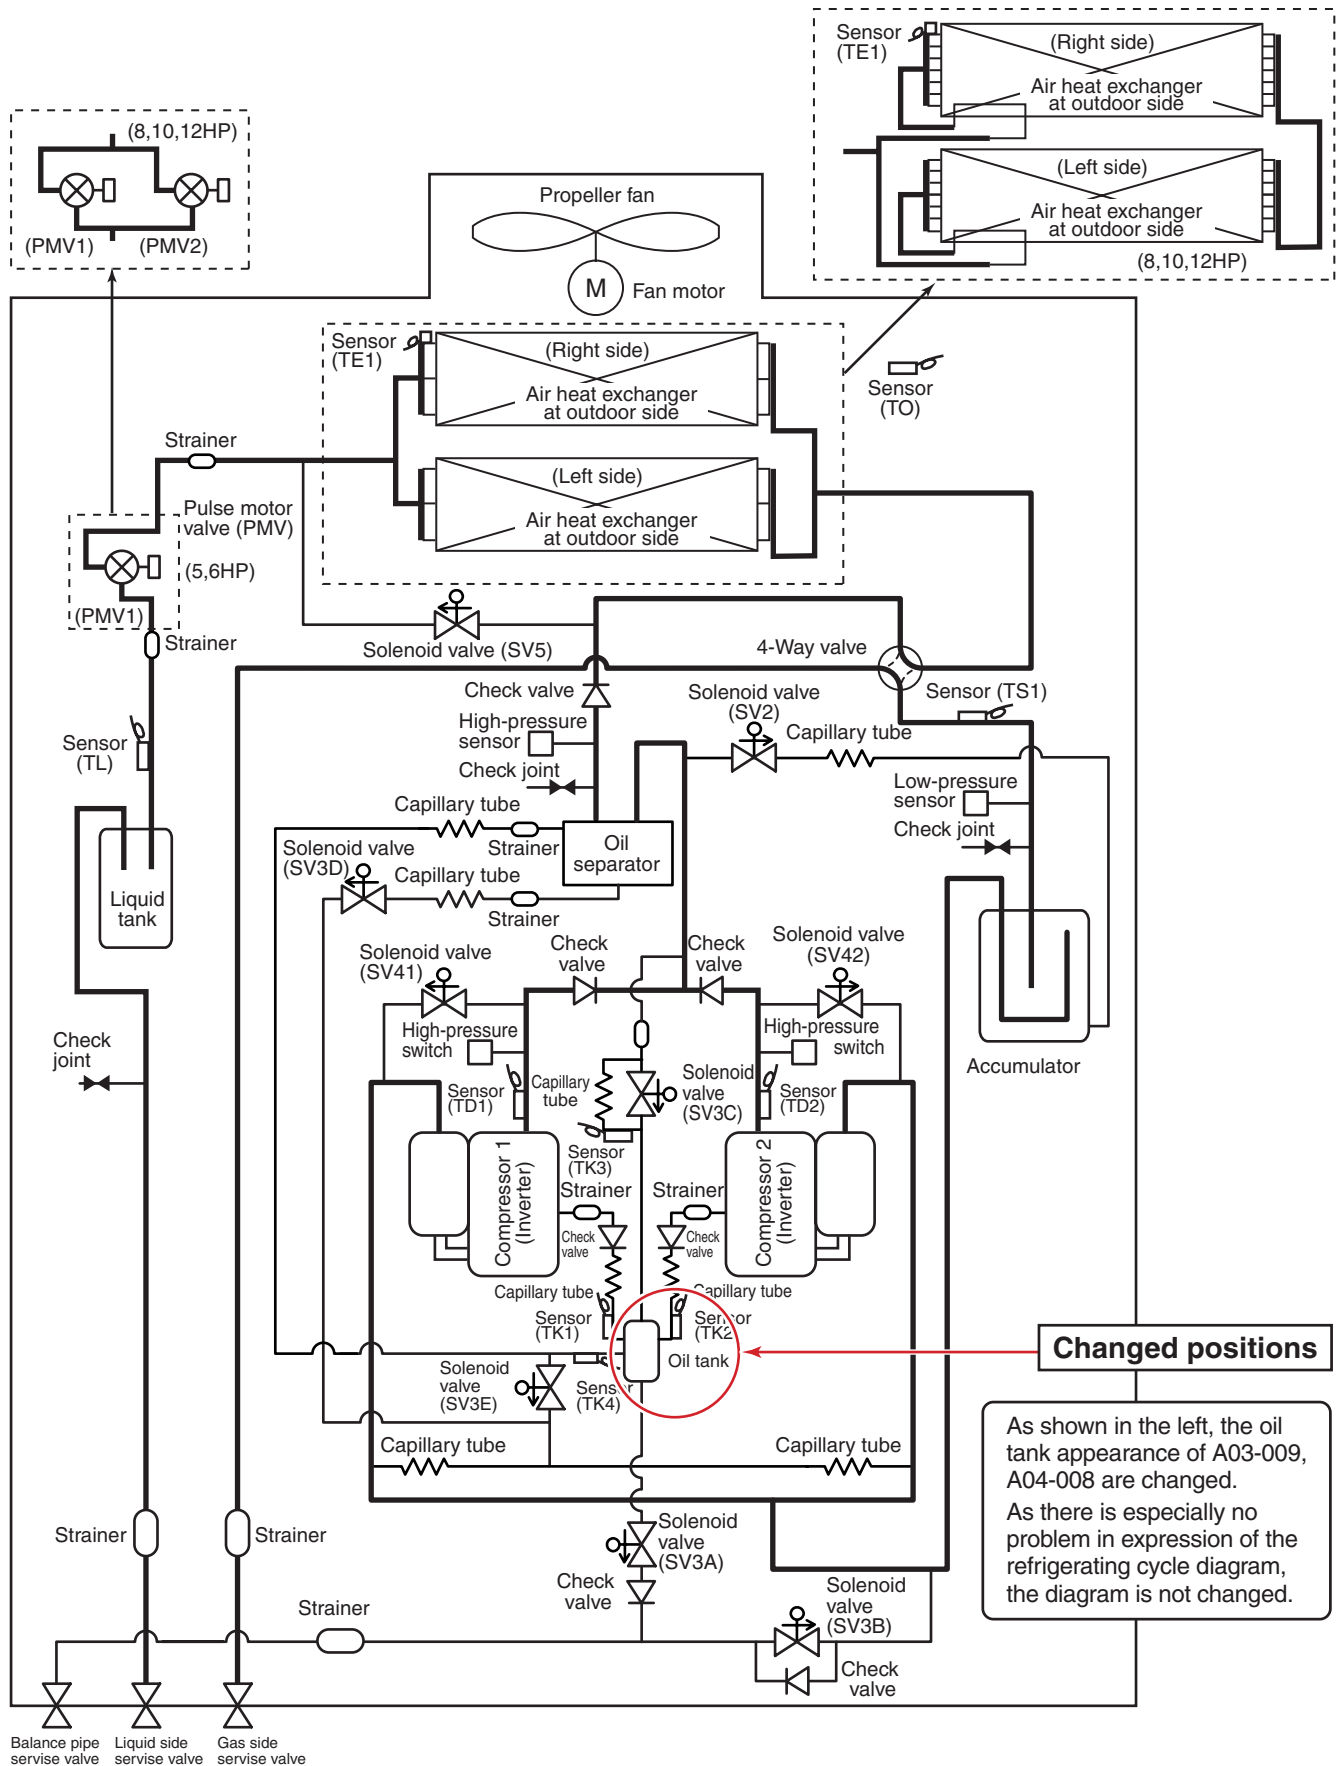

■ Inverter unit (8, 10, 12HP)

Model: MMY-MAP0802FT8-E, MMY-MAP1002FT8-E, MMY-MAP1202FT8-E

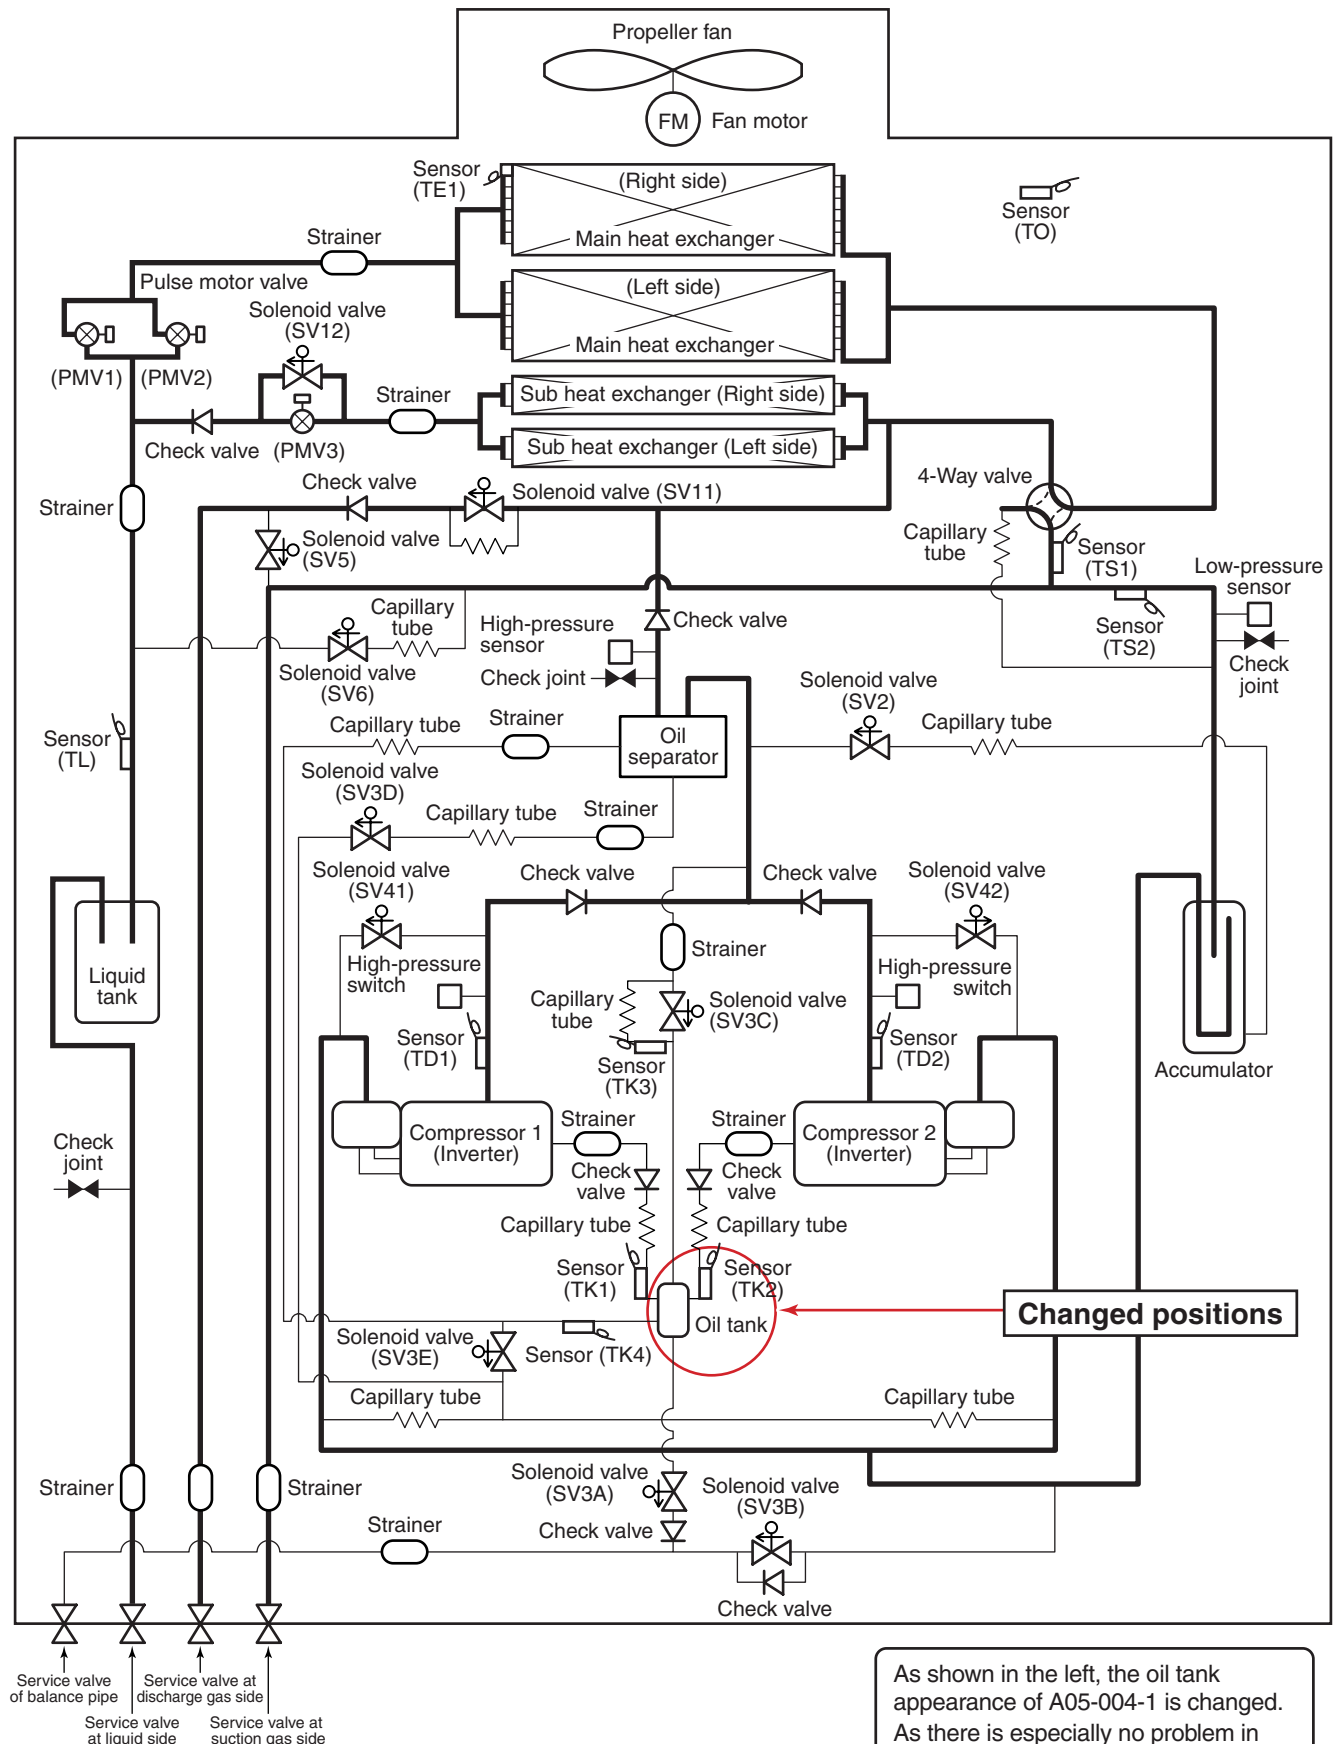

As shown in the left, the oil tank appearance of A05-004-1 is changed. As there is especially no problem in expression of the refrigerating cycle diagram, the diagram is not changed.

5-4. Refrigerant Recovery When Replacing the Compressor

■ How to operate the system during repairing of the defective outdoor unit

MMY-MAP0501HT8(-E), MMY-MAP0601HT8(-E), MMY-MAP0801HT8(-E),
MMY-MAP1001HT8(-E), MMY-MAP1201HT8(-E)

<Work procedure>

1. Follow to the abovementioned “13-1. Refrigerant Recovery in the Troubled Outdoor Unit”.

2. Next, recover the refrigerant in the system by using a recovery device, etc.

The refrigerant amount to be recovered is determined based upon the capacity of the troubled outdoor unit.
(See the following table.)

Example) In a case of backup for 10HP-outdoor unit in 30HP system:

in the original system HP (30HP system) = 36.0kg

Refrigerant amount in system HP (20HP system) after backup = 27.0kg



Refrigerant amount to be recovered = 36.0 – 27.0 = 9kg



3. For the unit which refrigerant has been recovered, execute “Outdoor Unit Backup Setup” in another section.
All the work has finished.

System HP	Combination of outdoor units				Refrigerant amount (kg)
5	5				8.5
6	6				8.5
8	8				13.5
10	10				14.5
12	12				15.5
14	8	6			20.5
16	8	8			24.0
18	10	8			24.0
20	10	10			27.0
22	8	8	6		32.5
	12	10			29.0
24	8	8	8		32.0
	12	12			31.0
26	10	8	8		32.0
28	10	10	8		34.0
30	10	10	10		36.0
32	8	8	8	8	42.0
	12	10	10		37.0
34	10	8	8	8	42.0
	12	12	10		39.0
36	10	10	8	8	42.0
	12	12	12		40.0
38	10	10	10	8	42.0
40	10	10	10	10	43.0
42	12	10	10	10	44.0
44	12	12	10	10	46.0
46	12	12	12	10	48.0
48	12	12	12	12	50.0



5-5. Replacing Method of Parts



<SMMS Series (A03-009, A04-008) >

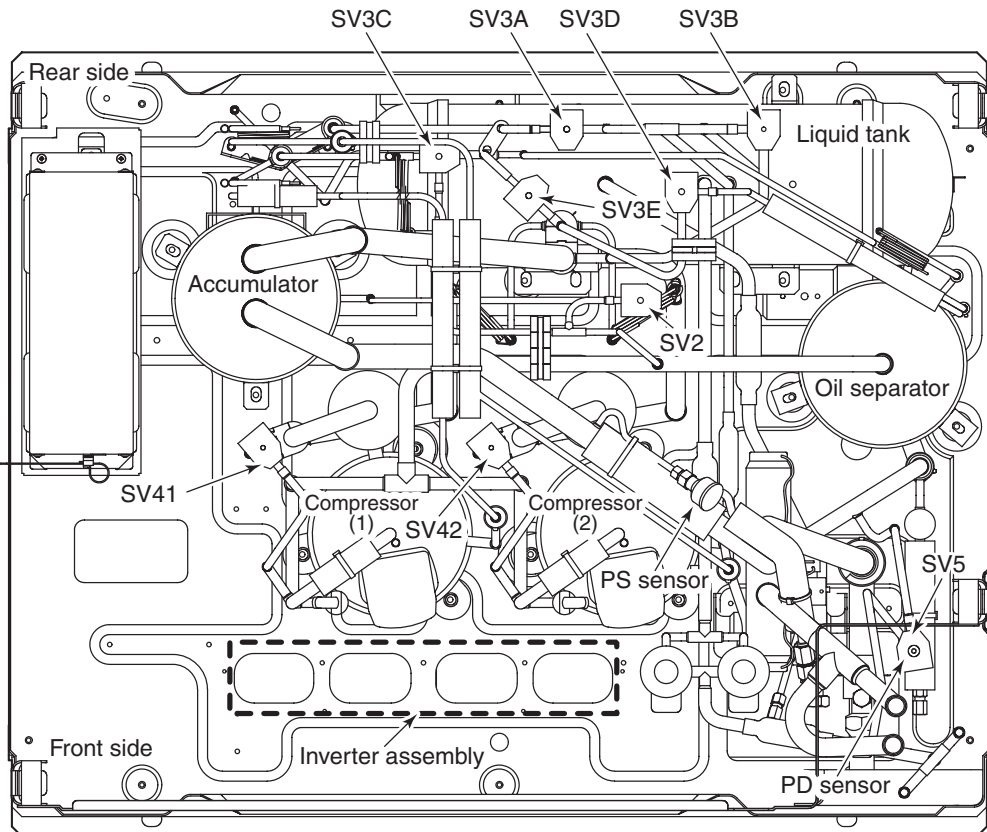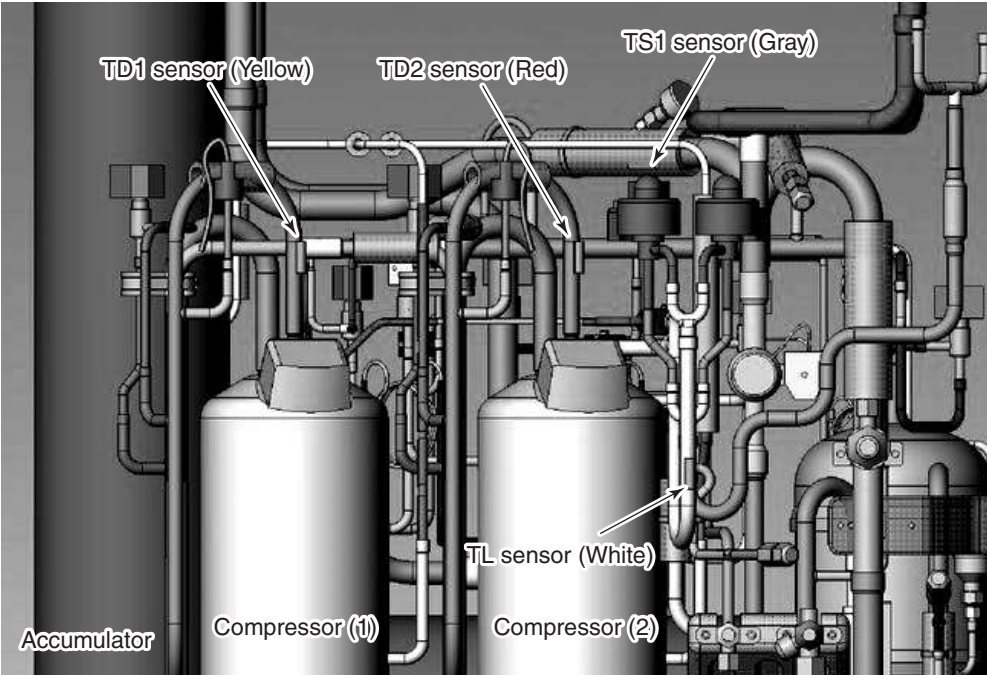No.	Part to be exchanged	Work procedure	Remarks
6	Pressure sensor positions of 2-way valve coil		
7	Temperature sensor positions and identification	<Front side of air conditioner> 	

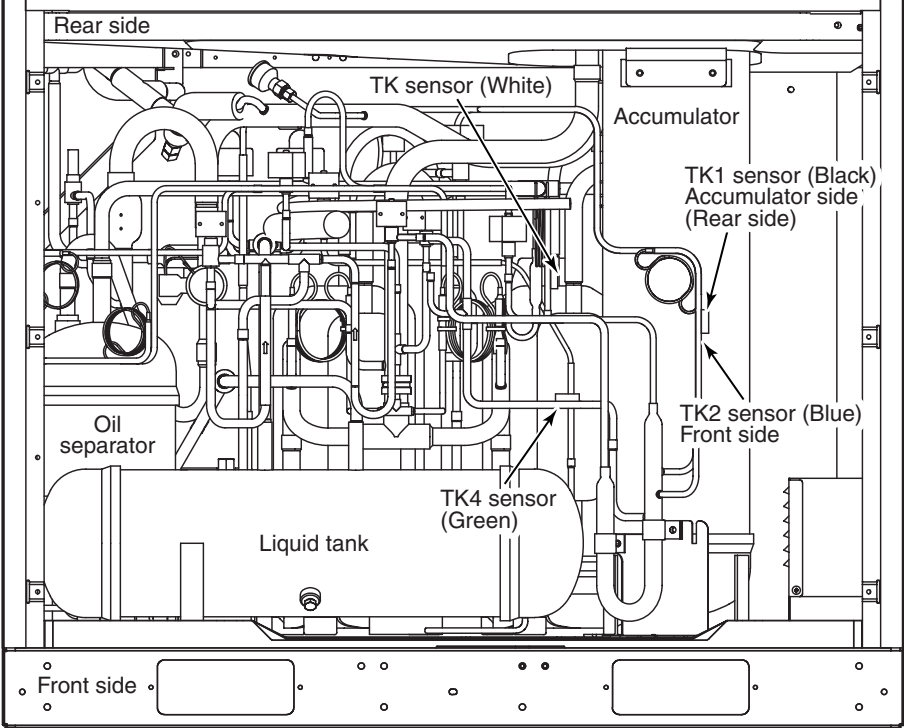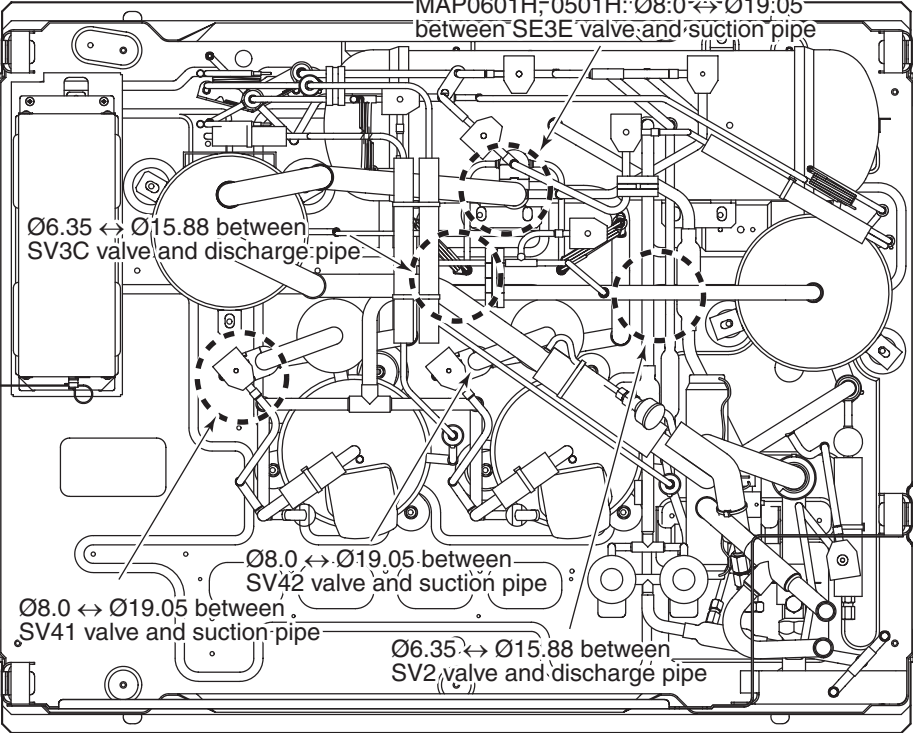No.	Part to be exchanged	Work procedure	Remarks
7	Temperature sensor positions and identification	<Rear side of air conditioner> 	
8	Attachment/detachment of pipe fixing rubber	In this air conditioner, (segmentation system) eyeglass rubber and SUS fix band are adopted for fixing the vibration system as one measures to improve the reliability. <Used positions of SUS fixing band: Total 5 positions> 	

<SHRM Series (A05-004-1) >

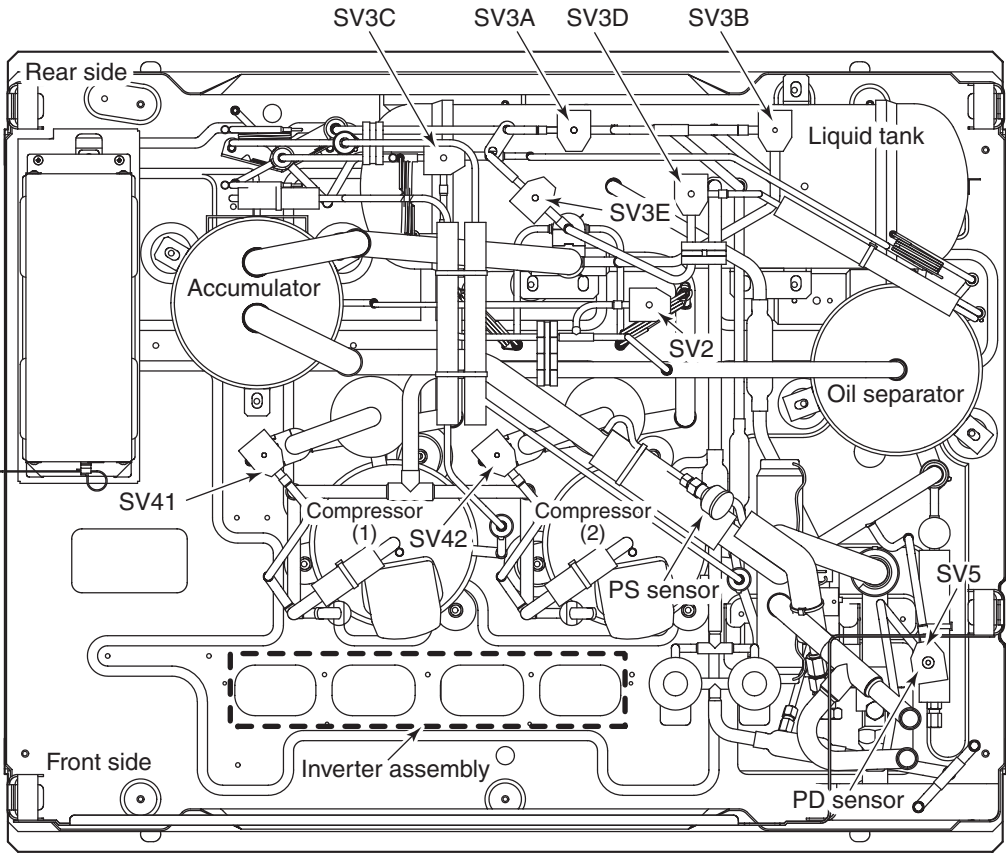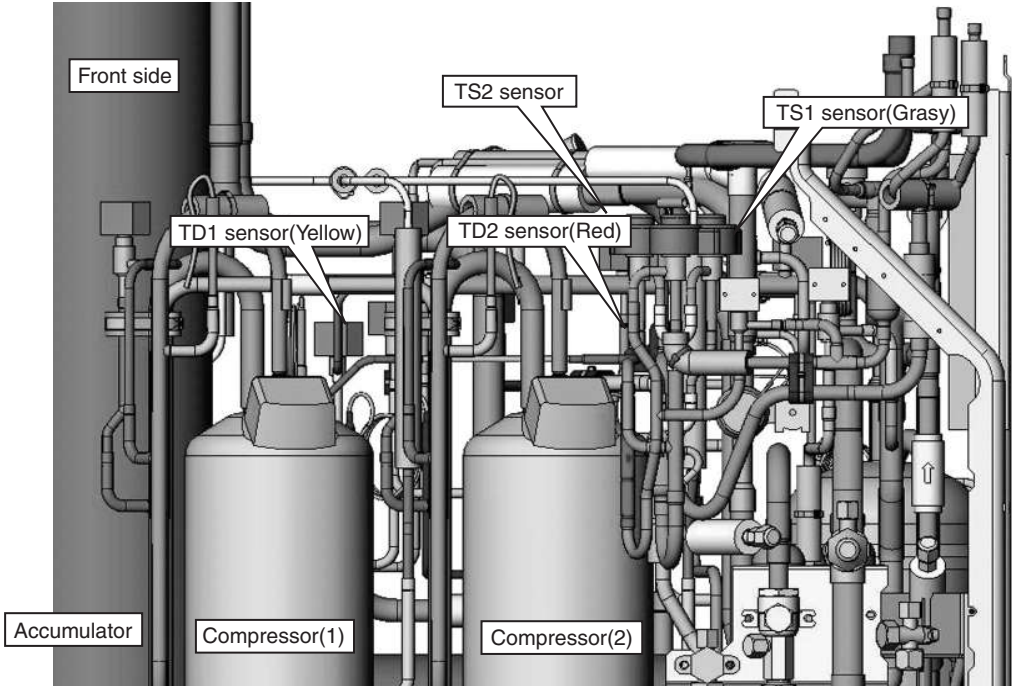No.	Part to be exchanged	Work procedure	Remarks
6	Pressure sensor positions of 2-way valve coil		
7	Temperature sensor positions and identification	<Front side of air conditioner> 	

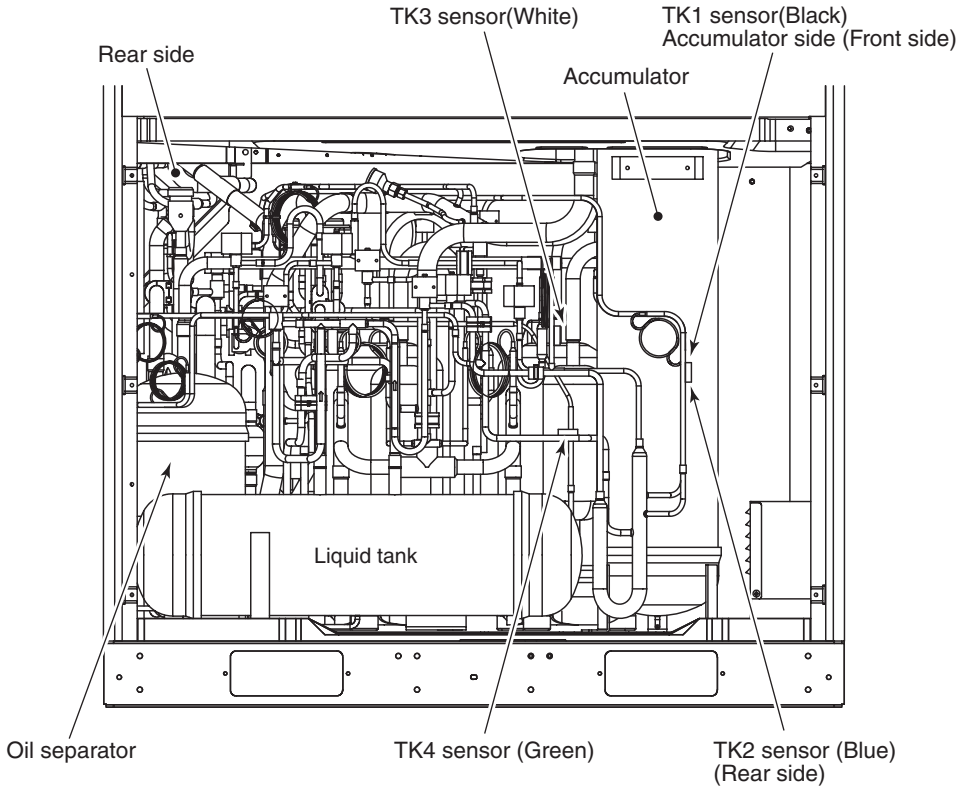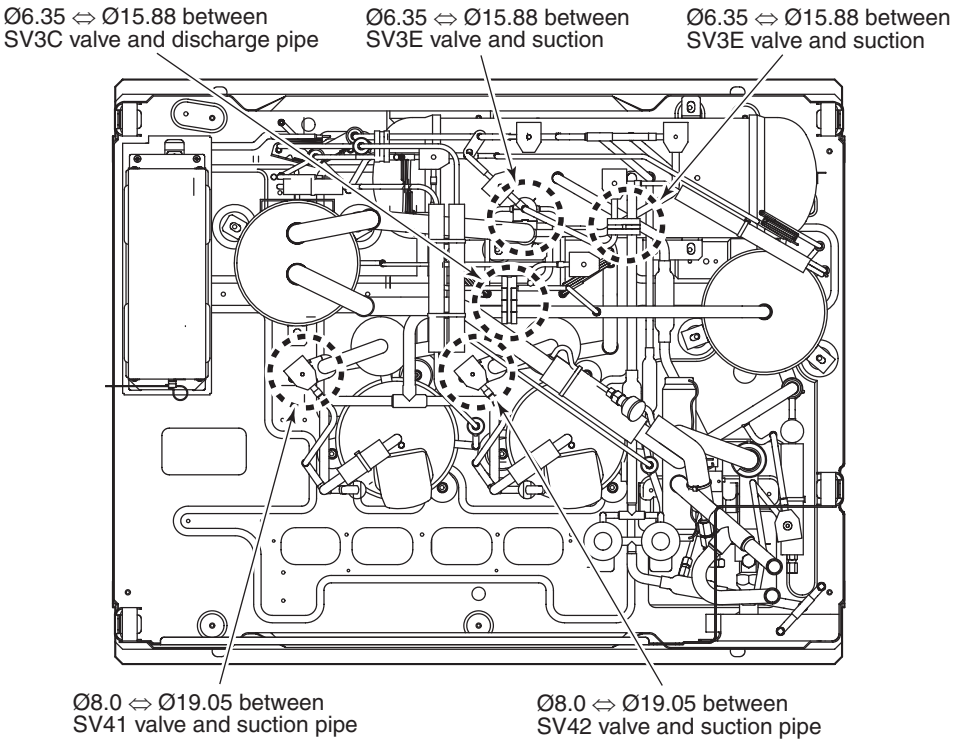No.	Part to be exchanged	Work procedure	Remarks
7	Temperature sensor positions and identification	<Rear side of air conditioner> 	
8	Attachment/detachment of pipe fixing rubber	This air conditioner has been designed so that vibration has been reduced to a minium by incorporating in the lower section of the unit, the use of eyeglass rubber fixing brackets and SUS bands. Both of which greatly help to reduce vibration and improve unit reliability. Used positions of SUS fixing band:Total 5 positions 	

5-6. P.C. Board Exchange Procedures (Outdoor Unit)

■ How to Check Fan Power Supply P.C. Board and Fan IPDU

The fan power supply P.C. board supplies DC power. It supplies DC280V for the fan IPDU, and DC12V and DC7V for the control power supply respectively. If the control power is not supplied, a communication error (Error code [E31]) is out.

1. How to check fan power supply P.C. board (MCC-1439)


As shown in the following table, measure the voltage of the check positions with a digital tester.

No.	Check item	Check position	Criteria
1	DC280V output	Between CN500 ① and ③	DC260 to DC340V
2	Control power voltage	Between CN500 ① and ⑤	DC12V
3		Between CN500 ② and ⑤	DC7V





2. How to check fan IPDU





1. Check that the lead wires are correctly inserted into 250 fasten terminal of DC280V input and into the communication connector (CN01).
2. After then replace the fan IPDU if an abnormality is recognized.


<MCC-1439 Front View>

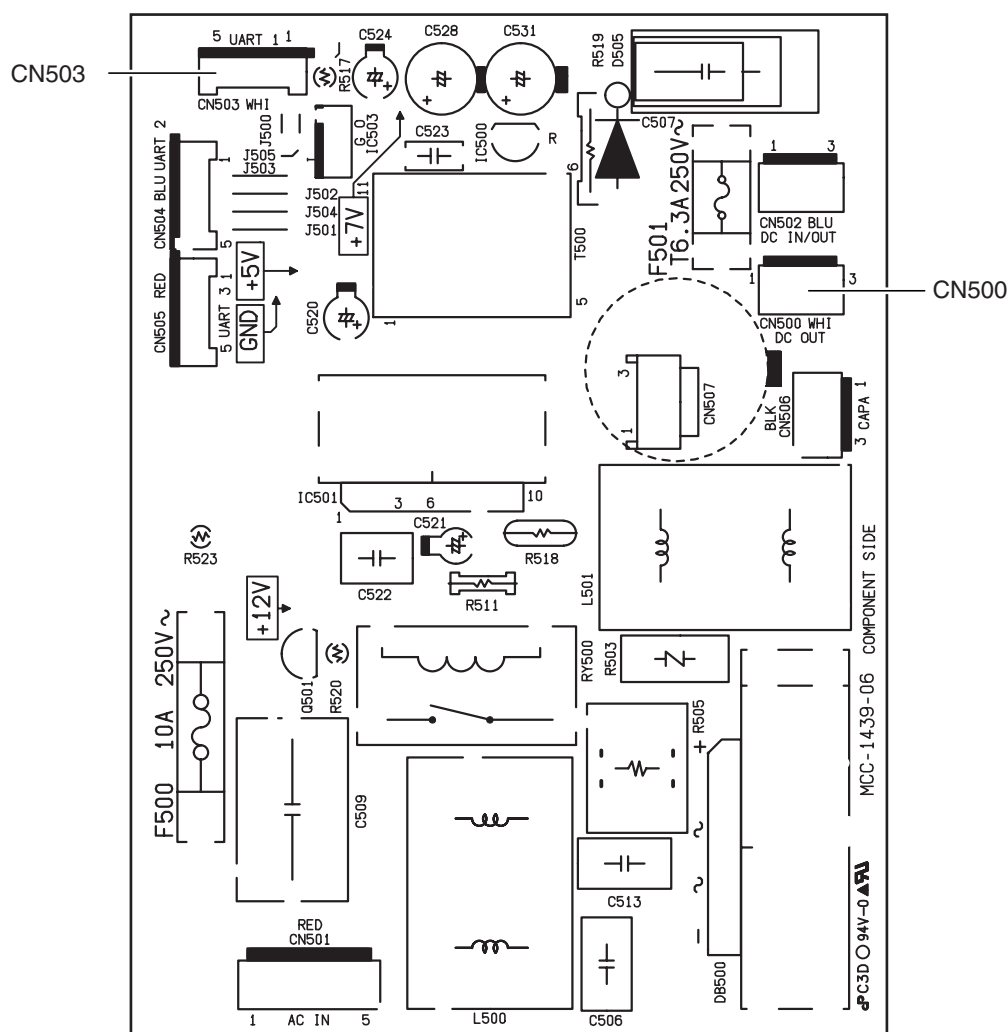

6. DETACHMENTS (Passive Filter Circuit)

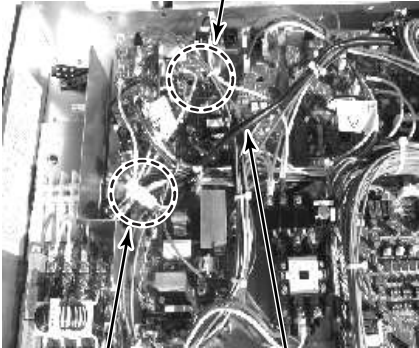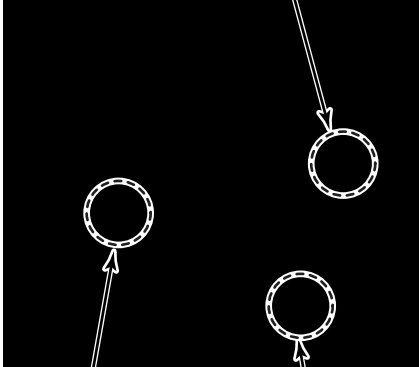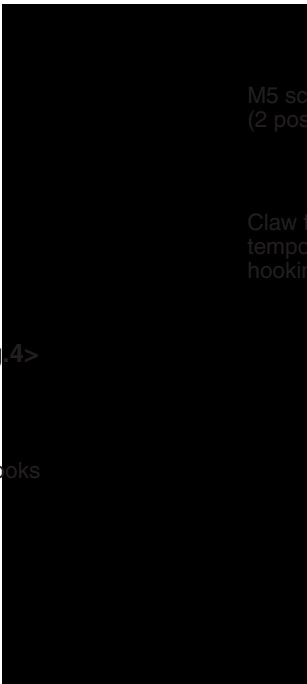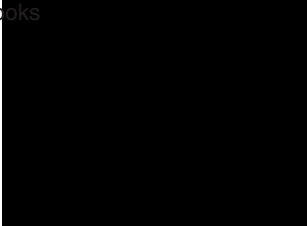No.	Part name	Work procedure	Remarks
10	Passive filter	⚠ CAUTION Wear protective clothing on your hands as other components may cause injury etc. ⚠ WARNING Never open the cabinet while 5 minutes after turn off the power supply. <Disassembling> 1) Stop unit operation and turn off power supply to unit. 2) Remove Front panel. (Screw M5 × 10 , 7pcs) 3) Remove cover of the electric parts box. (Screw M4 × 10 , 2 pcs) 4) Open connector(CN507,yellow) of "Power supply P.C. board for FAN", and open relay connector (white). <Fig.1> 5) Passive filter wiring is fixed at 3 places. Remove the fixation shown in the "Fig.2". (Binding band, 2 pcs. Wire clamp, 1pc) <Fig.2> 6) Remove screws fixing the electric parts box. (1 pc. each at upper and lower sides.) 7) Push down lightly the fixing claw at lower side to take off the claw. (Lower part of the box is out forward.) <Fig.3> 8) Take off hooking claw at upper side while holding the ceiling board with both hands. <Fig.4>	<Fig.1> CN507 of "Power supply P.C. board for FAN"  Relay connector Passive filter wiring <Fig.2> Binding band (B)  Binding band (A) Wire clamp <Fig.3>  M5 screws (2 positions) Claw for temporary hooking <Fig.4> Hooks 

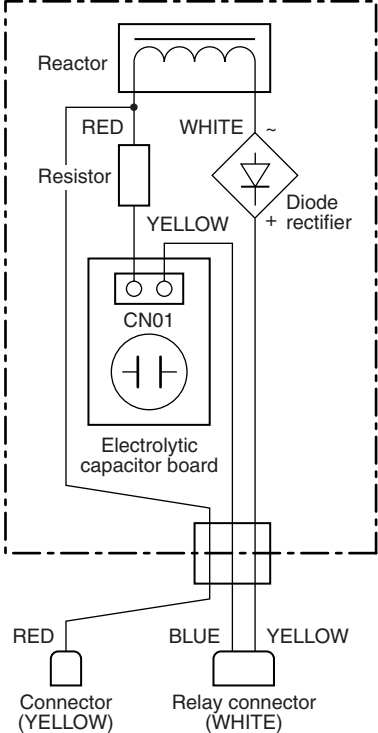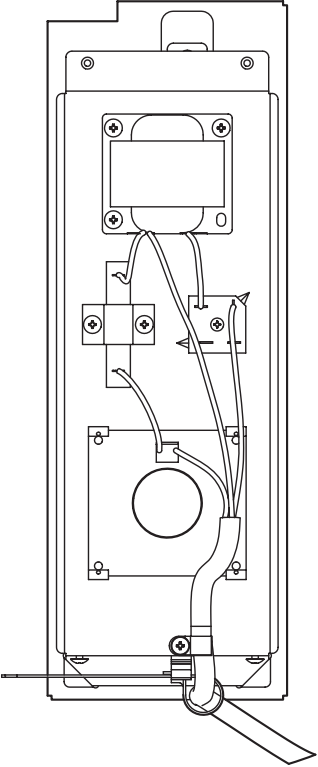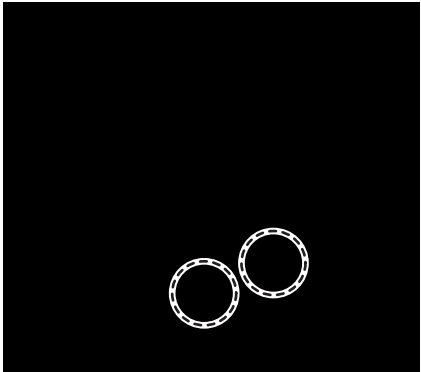
No.	Part name	Work procedure	Remarks
10	Passive filter (Continued)	9) Remove rear panel. (Screw M5 × 10 , 7pcs) 10) Remove the screw which is fixing the passive filter box. (Screw M4 × 10 , 2 pcs) <Fig.6> 11) Take out the passive filter box outside. <Fig.7> 12) Remove The lid of the passive filter box. (Screw M4 × 10 , 4pcs) <Fig.8> <Fig.9>  13) Check the short circuit of each part, and opening. And correct the fault parts. <Fig.10> 	<Fig.6>  <Fig.8> 

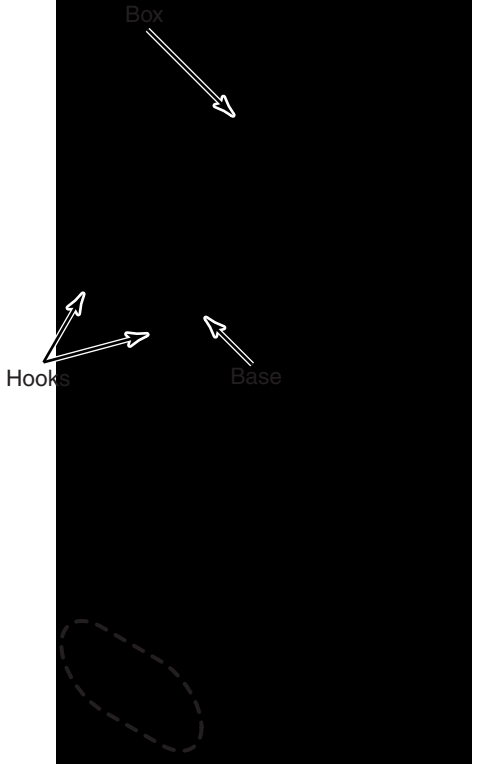No.	Part name	Work procedure	Remarks
10	Passive filter (Continued)	<Assembly> Assembling by contrary procedure of above 10) → 12). Is connector of the power supply P.C. board for fan connected? Connector No.: CN501, CN502, CN503, CN505, CN506, CN507 Power supply P.C. board A'SSY for Fan: MCC-1439 Is the passive filter connector connected? <Fig. 9> (DC260 to DC340V) <u>Notice</u> When a box fixed, it hooks on the hook of base. <Fig.11>	<Fig.11> 

7. EXPLODED VIEWS AND PARTS LIST


7-1. Outdoor Unit

MMY-MAP0501HT8-E (5HP), MMY-MAP0601HT8-E (6HP), MMY-MAP0801HT8-E (8HP),
MMY-MAP1001HT8-E (10HP), MMY-MAP1201HT8-E (12HP)

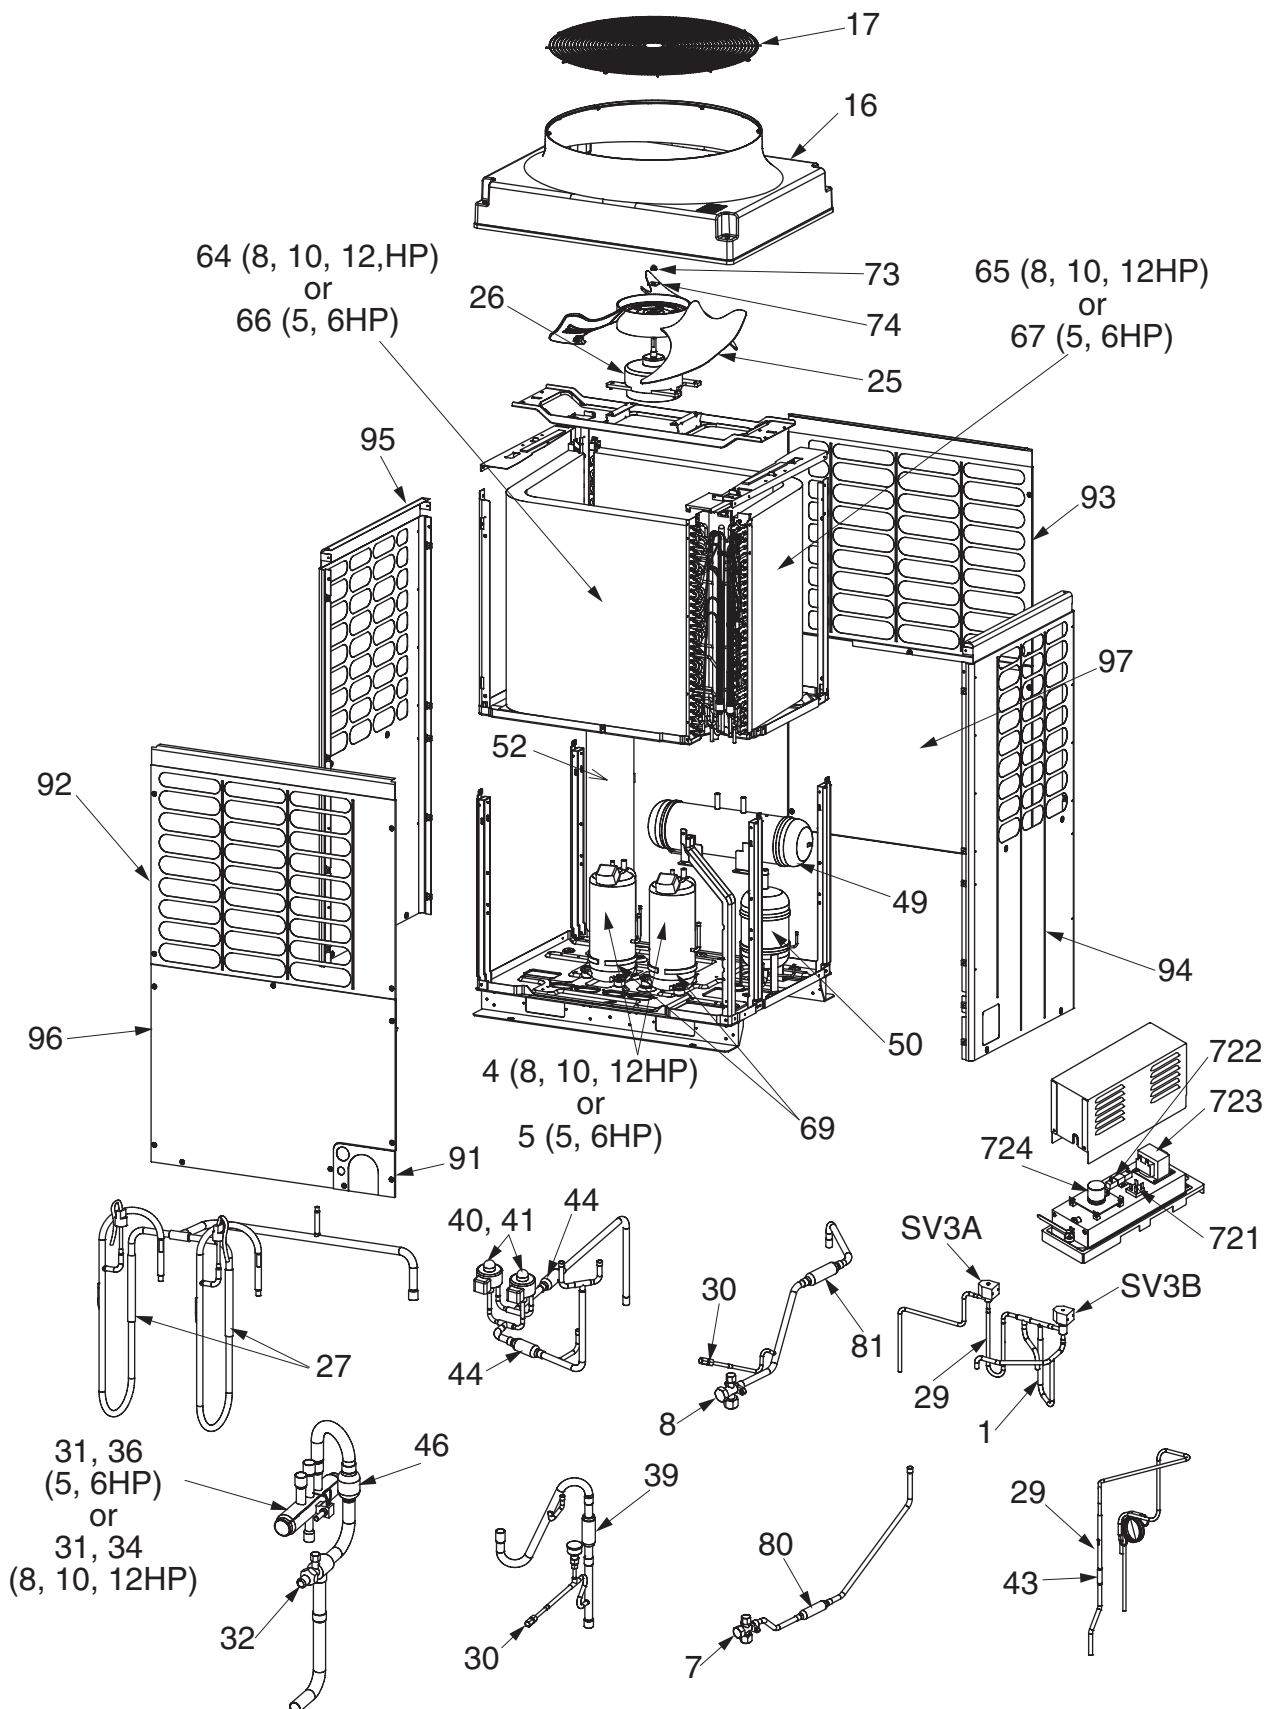

Location No.	Part No.	Description	Model Name MMY- MAP				
			1201HT8-E	1001HT8-E	0801HT8-E	0601HT8-E	0501HT8-E
1	43146737	Valve, Checked, YCV5P-33GME-1	1	1	1	1	1
4	43041781	Compressor, DA421A3FB-23M	2	2	2		
5	43041782	Compressor, DA351A3FB-23M				2	2
7	43046442	Valve, Packed, 9.52 DIA	1	1	1	2	2
8	43146680	Valve, Packed, 12.7	1	1	1		
16	43100265	Cabinet, Up	1	1	1	1	1
17	43119466	Guard, Fan	1	1	1	1	1
25	43120219	Fan, Propeller, DIA 710, ASG	1	1	1	1	1
26	4312C004	Motor, Fan, DC280V, MF-230-600-1R	1	1	1	1	1
27	43146715	Valve, Checked, BCV-804DY	2	2	2	2	2
29	43146736	Valve, Checked, YCV3-22GME-1	3	3	3	3	3
30	43146676	Joint, Check	3	3	3	3	3
31	43146722	Coil, Solenoid, STF-01AJ502E1	1	1	1	1	1
32	43146727	Valve, Gas, DIA 25	1	1	1		
34	43146698	Valve, 4-Way, STF-0731G	1	1	1		
36	43146687	Valve, 4-Way, STF-0401G				1	1
39	43146734	Valve, Check, ZGV-S55B-A	1	1	1	1	1
40	43146709	Valve, PMV, HAM-BD24TF-1	2	2	2	1	1
41	43146708	Coil, PMV, HAM-MD12TF-3	2	2	2	1	1
43	4314Q060	Strainer, DIA 12.7, C1220T-H	2	2	2	2	2
44	4314Q056	Strainer, DIA 25.4, C1220T-H	2	2	2		
46	4314Q052	Strainer, DIA 45, C1220T-H	1	1	1		
49	43148202	Tank, Liquid	1	1	1	1	1
50	43148192	Separator	1	1	1	1	1
63	43149325	Band, Fix, SUS304	4	4	4	4	4
64	4314G264	Condenser Assembly, Three Row	1	1	1		
65	4314G265	Condenser Assembly, Three Row	1	1	1		
66	4314G249	Condenser Assembly, One Row				1	1
67	4314G250	Condenser Assembly, One Row				1	1
69	43157276	Heater, Case, 29W, AC240V	3	3	3	3	3
73	43197175	Nut, Flange, M10, SWCH12R	1	1	1	1	1
74	43197176	Washer, SPHC	1	1	1	1	1
80	4314Q055	Strainer, DIA 19.05, C1220T-H	1	1	1	1	1
81	4314Q057	Strainer, DIA 25.4, C1220T-H	1	1	1		
91	43100396	Panel, CGCD2-Z08-C77	1	1	1	1	1
92	43100406	Cabinet Assembly, Front, Up	1	1	1	1	1
93	43100407	Cabinet Assembly, Back, Up	1	1	1	1	1
94	43100408	Cabinet Assembly, Side, Right	1	1	1	1	1
95	43100409	Cabinet Assembly, Side, Left	1	1	1	1	1
96	43100410	Cabinet Assembly, Front, Down	1	1	1	1	1
97	43100411	Cabinet Assembly, Back, Down	1	1	1	1	1
721	43031110	Diode, 25A, 600V, *GBPC-2506	1	1	1	1	1
722	43155214	Resistor, 1Ω, 20W	1	1	1	1	1
723	43158207	Reactor, CH-68	1	1	1	1	1
724	4316V362	P.C. Board Assembly, Passive, MCC-1580	1	1	1	1	1


**MMY-MAP0501HT8-E (5HP), MMY-MAP0601HT8-E (6HP), MMY-MAP0801HT8-E (8HP),
MMY-MAP1001HT8-E (10HP), MMY-MAP1201HT8-E (12HP)**

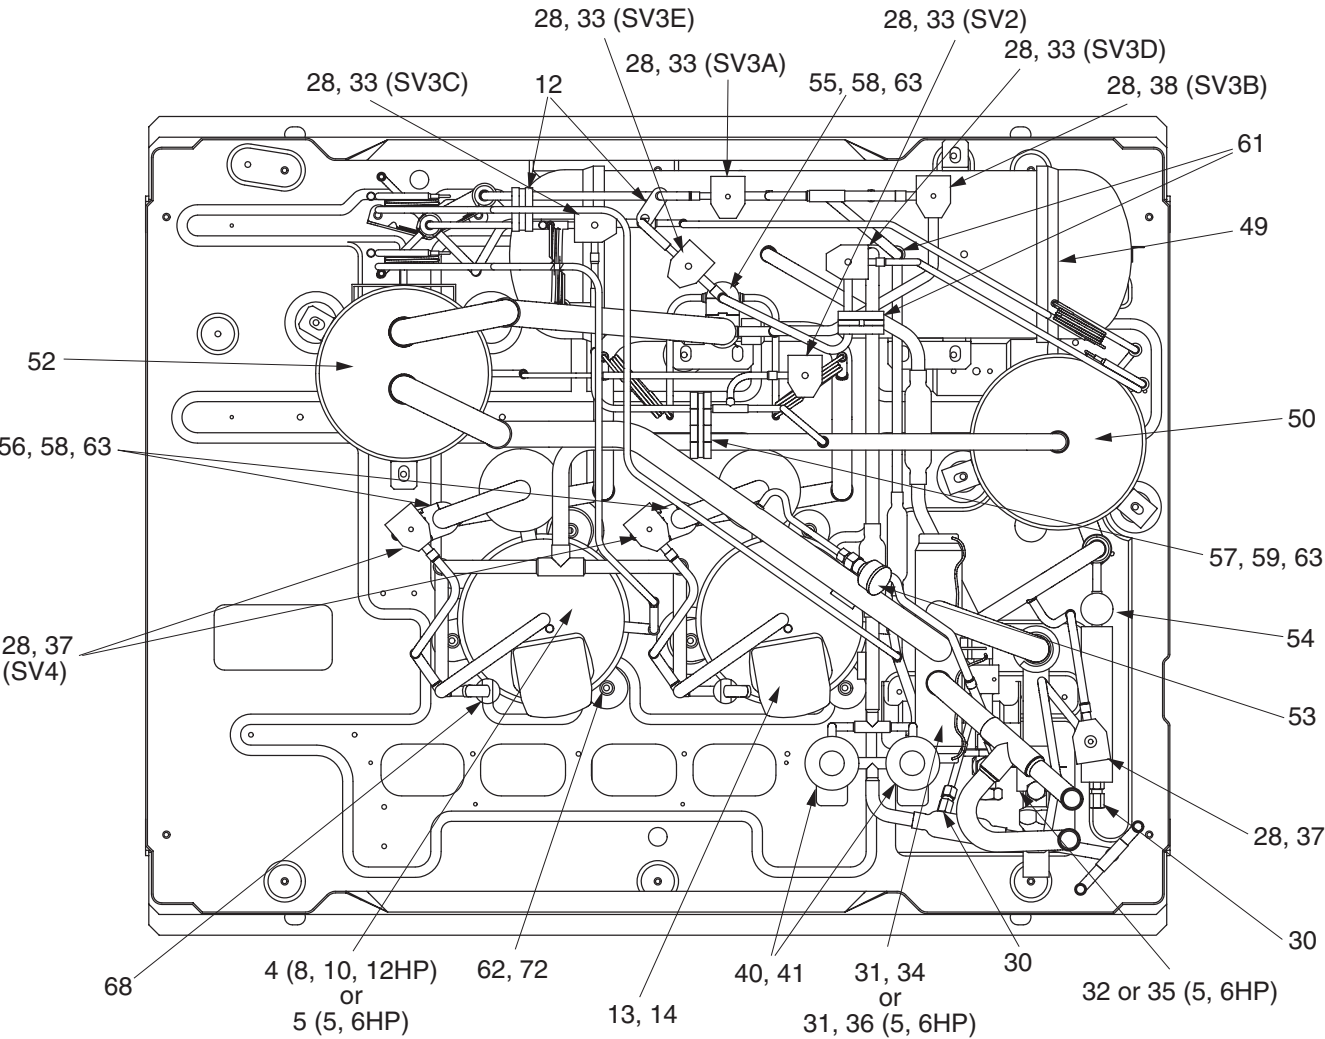

Location No.	Part No.	Description	Model Name MMY- MAP				
			1201HT8-E	1001HT8-E	0801HT8-E	0601HT8-E	0501HT8-E
4	43041781	Compressor, DA421A3FB-23M	2	2	2		
5	43041782	Compressor, DA351A3FB-23M				2	2
12	43049683	Band, DIA 8, EPDM	2	2	2	2	2
13	43050407	Thermostat, Bimetal	2	2	2	2	2
14	43063317	Holder, Thermostat	2	2	2	2	2
28	43146660	Coil, Solenoid, AC220-240V, 50Hz, VPV-MOAJ510B0	9	9	9	9	9
30	43146676	Joint, Check	3	3	3	3	3
31	43146722	Coil, Solenoid, STF-01AJ502E1	1	1	1	1	1
32	43146727	Valve, Gas, DIA 25	1	1	1		
33	43146711	Valve, 2-Way, VPV-122DQ1	5	5	5	5	5
34	43146698	Valve, 4-Way, STF-0731G	1	1	1		
35	43146699	Valve, Ball, B5/8F, Rohs				1	1
36	43146687	Valve, 4-Way, STF-0401G				1	1
37	43146712	Valve, 2-Way, VPV-303DQ1	3	3	3	3	3
38	43146730	Valve, 2-Way, VPV-603DQ2	1	1	1	1	1
40	43146709	Valve, PMV, HAM-BD24TF-1	2	2	2	1	1
41	43146708	Coil, PMV, HAM-MD12TF-3	2	2	2	1	1
49	43148202	Tank, Liquid	1	1	1	1	1
50	43148192	Separator	1	1	1	1	1
52	43148200	Accumulator, 20L	1	1	1	1	1
53	43149377	Sensor Assembly, Low Pressure, 150XA4-L1	1	1	1	1	1
54	43149378	Sensor Assembly, High Pressure, 150XA4-H3	1	1	1	1	1
55	43149317	Rubber, Supporter, Pipe, DIA 25.4	1	1	1		
56	43149318	Rubber, Supporter, Pipe, DIA 19.0	2	2	2	3	3
57	43149319	Rubber, Supporter, Pipe, DIA 15.9	1	1	1	1	1
58	43149320	Rubber, Supporter, Pipe, DIA 8.0	3	3	3	3	3
59	43149321	Rubber, Supporter, Pipe, DIA 6.4	1	1	1	1	1
61	43149323	Rubber, Supporter, Pipe, DIA 9.52-12.7	2	2	2	2	2
62	43149324	Rubber, Cushion, EPDM	6	6	6	6	6
63	43149325	Band, Fix, SUS304	4	4	4	4	4
68	43151283	Switch, Pressure, ACB-4UB32W	2	2	2	2	2
72	43197184	Bolt, Compressor, M6, SWCH18A	6	6	6	6	6


Refrigeration Circuit Diagram

MMY-MAP0501HT8-E (5HP), MMY-MAP0601HT8-E (6HP), MMY-MAP0801HT8-E (8HP),
MMY-MAP1001HT8-E (10HP), MMY-MAP1201HT8-E (12HP)

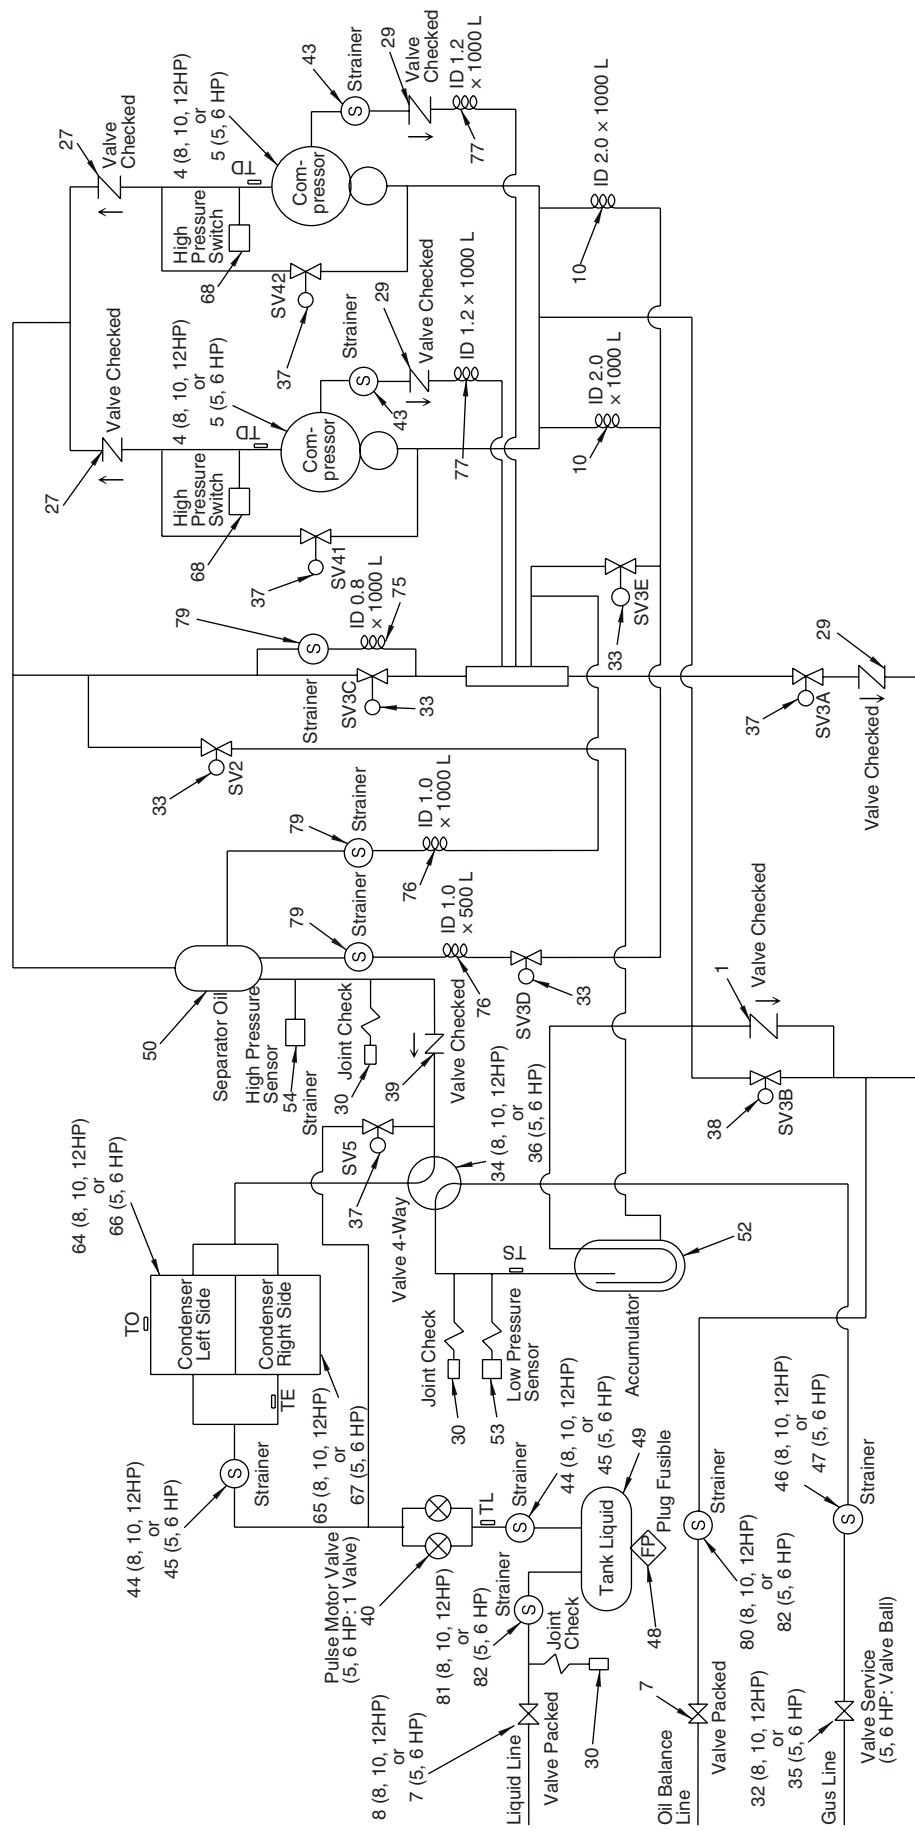

Location No.	Part No.	Description	Model Name MMY- MAP				
			1201HT8-E	1001HT8-E	0801HT8-E	0601HT8-E	0501HT8-E
1	43146737	Valve, Checked, YCV5P-33GME-1	1	1	1	1	1
4	43041781	Compressor, DA421A3FB-23M	2	2	2		
5	43041782	Compressor, DA351A3FB-23M				2	2
7	43046442	Valve, Packed, 9.52 DIA	1	1	1	2	2
8	43146680	Valve, Packed, 12.7	1	1	1		
10	43047527	Tube, Capillary, ID 2.0 x 2000L	1	1	1	1	1
27	43146715	Valve, Checked, BCV-804DY	2	2	2	2	2
29	43146736	Valve, Checked, YCV3-22GME-1	3	3	3	3	3
30	43146676	Joint, Check	3	3	3	3	3
32	43146727	Valve, Gas, DIA 25	1	1	1		
33	43146711	Valve, 2-Way, VPV-122DQ1	5	5	5	5	5
34	43146698	Valve, 4-Way, STF-0731G	1	1	1		
35	43146699	Valve, Ball, B5/8F, Rohs				1	1
36	43146687	Valve, 4-Way, STF-0401G				1	1
37	43146712	Valve, 2-Way, VPV-303DQ1	3	3	3	3	3
38	43146730	Valve, 2-Way, VPV-603DQ2	1	1	1	1	1
39	43146734	Valve, Checked, ZGV-S55B-A	1	1	1	1	1
40	43146709	Valve, PMV, HAM-BD24TF-1	2	2	2	1	1
43	4314Q060	Strainer, DIA 12.7, C1220T-H	2	2	2	2	2
44	4314Q056	Strainer, DIA 25.4, C1220T-H	2	2	2		
45	4314Q058	Strainer, DIA 25.4				2	2
46	4314Q052	Strainer, DIA 45, C1220T-H	1	1	1		
47	4314Q053	Strainer, DIA 21, C1220T-H				1	1
48	43148220	Plug, Fusible, 73 C	1	1	1	1	1
49	43148202	Tank, Liquid	1	1	1	1	1
50	43148192	Separator	1	1	1	1	1
52	43148200	Accumulator, 20L	1	1	1	1	1
53	43149377	Sensor Assembly, Low Pressure, 150XA4-L1	1	1	1	1	1
54	43149378	Sensor Assembly, High Pressure, 150XA4-H3	1	1	1	1	1
64	4314G264	Condenser Assembly, Three Row	1	1	1		
65	4314G265	Condenser Assembly, Three Row	1	1	1		
66	4314G249	Condenser Assembly, One Row				1	1
67	4314G250	Condenser Assembly, One Row				1	1
68	43151283	Switch, Pressure, ACB-4UB32W	2	2	2	2	2
75	44246235	Tube, Capillary, Bypass, 0.8 DIA	1	1	1	1	1
76	44246236	Tube, Capillary, Bypass, 1.0 DIA	1	1	1	1	1
77	44246239	Tube, Capillary, 1.2 DIA	1	1	1	1	1
79	4314Q054	Strainer, DIA 12.7, C1220T-H	3	3	3	3	3
80	4314Q055	Strainer, DIA 19.05, C1220T-H	1	1	1	1	1
81	4314Q057	Strainer, DIA 25.4, C1220T-H	1	1	1		
82	4314Q059	Strainer, DIA 25.4				1	1


**MMY-MAP0501HT8-E (5HP), MMY-MAP0601HT8-E (6HP), MMY-MAP0801HT8-E (8HP),
MMY-MAP1001HT8-E (10HP), MMY-MAP1201HT8-E (12HP)**

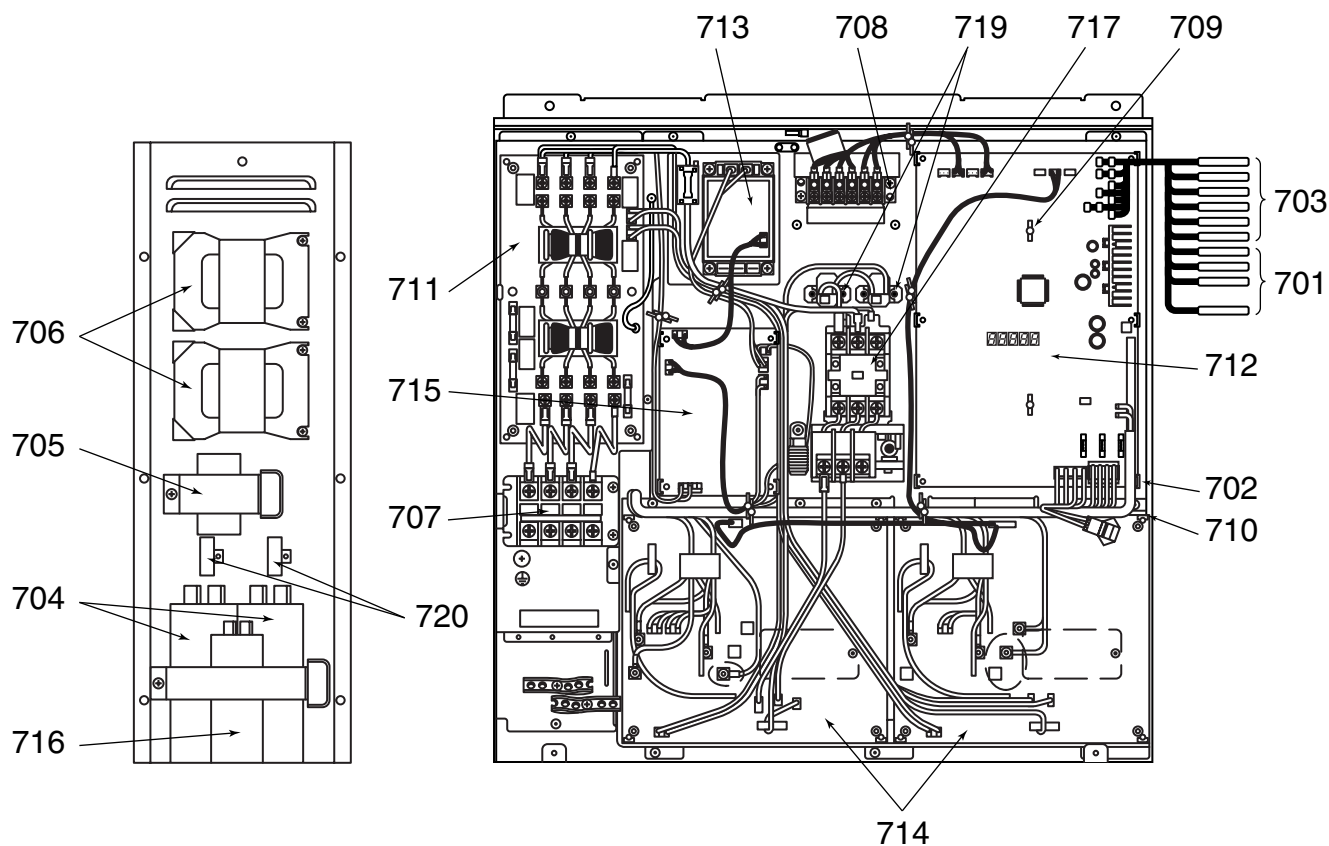

Location No.	Part No.	Description	Model Name MMY- MAP				
			1201HT8-E	1001HT8-E	0801HT8-E	0601HT8-E	0501HT8-E
701	43050382	Sensor, TC (F6)	4	4	4	4	4
702	43063248	Supporter Assembly	3	3	3	3	3
703	43150315	Sensor, TD (F6)	6	6	6	6	6
704	43155176	Capacitor, 400V DC, 1500 μ F	2	2	2	2	2
705	43158186	Transformer, TT-01-03	1	1	1	1	1
706	43158183	Reactor, CH-44	2	2	2	2	2
707	43160559	Terminal Block, 4P, AC600V, 30A	1	1	1	1	1
708	43160548	Terminal, 6P, AC30V, 1A	1	1	1	1	1
709	43163017	Supporter	2	2	2	2	2
710	43163048	Supporter Assembly	1	1	1	1	1
711	4316V366	P.C. Board Assembly, Noise-Filter, MCC-1366	1	1	1	1	1
712	4316V263	P.C. Board Assembly, Interface, MCC-1429	1	1	1	1	1
713	4316V237	P.C. Board Assembly, Fan-IPDU, IPDU-2D16DA1	1	1	1	1	1
714	4316V245	P.C. Board Assembly, A3-IPDU, MCC-1502	2	2	2	2	2
715	4316V360	P.C. Board Assembly, Power, MCC-1439	1	1	1	1	1
716	43155194	Capacitor, 400V DC, 1000 μ F	1	1	1	1	1
717	43152506	Electro Magnetic Switch, FW-2S	1	1	1	1	1
719	43153006	PTC-Thermistor, ZPROYCE101A500	2	2	2	2	2
720	43155197	Resistor, 56k Ω , 15W	2	2	2	2	2


7-2. Outdoor Unit

MMY-MAP0501T8-E (5HP), MMY-MAP0601T8-E (6HP), MMY-MAP0801T8-E (8HP),
MMY-MAP1001T8-E (10HP), MMY-MAP1201T8-E (12HP)

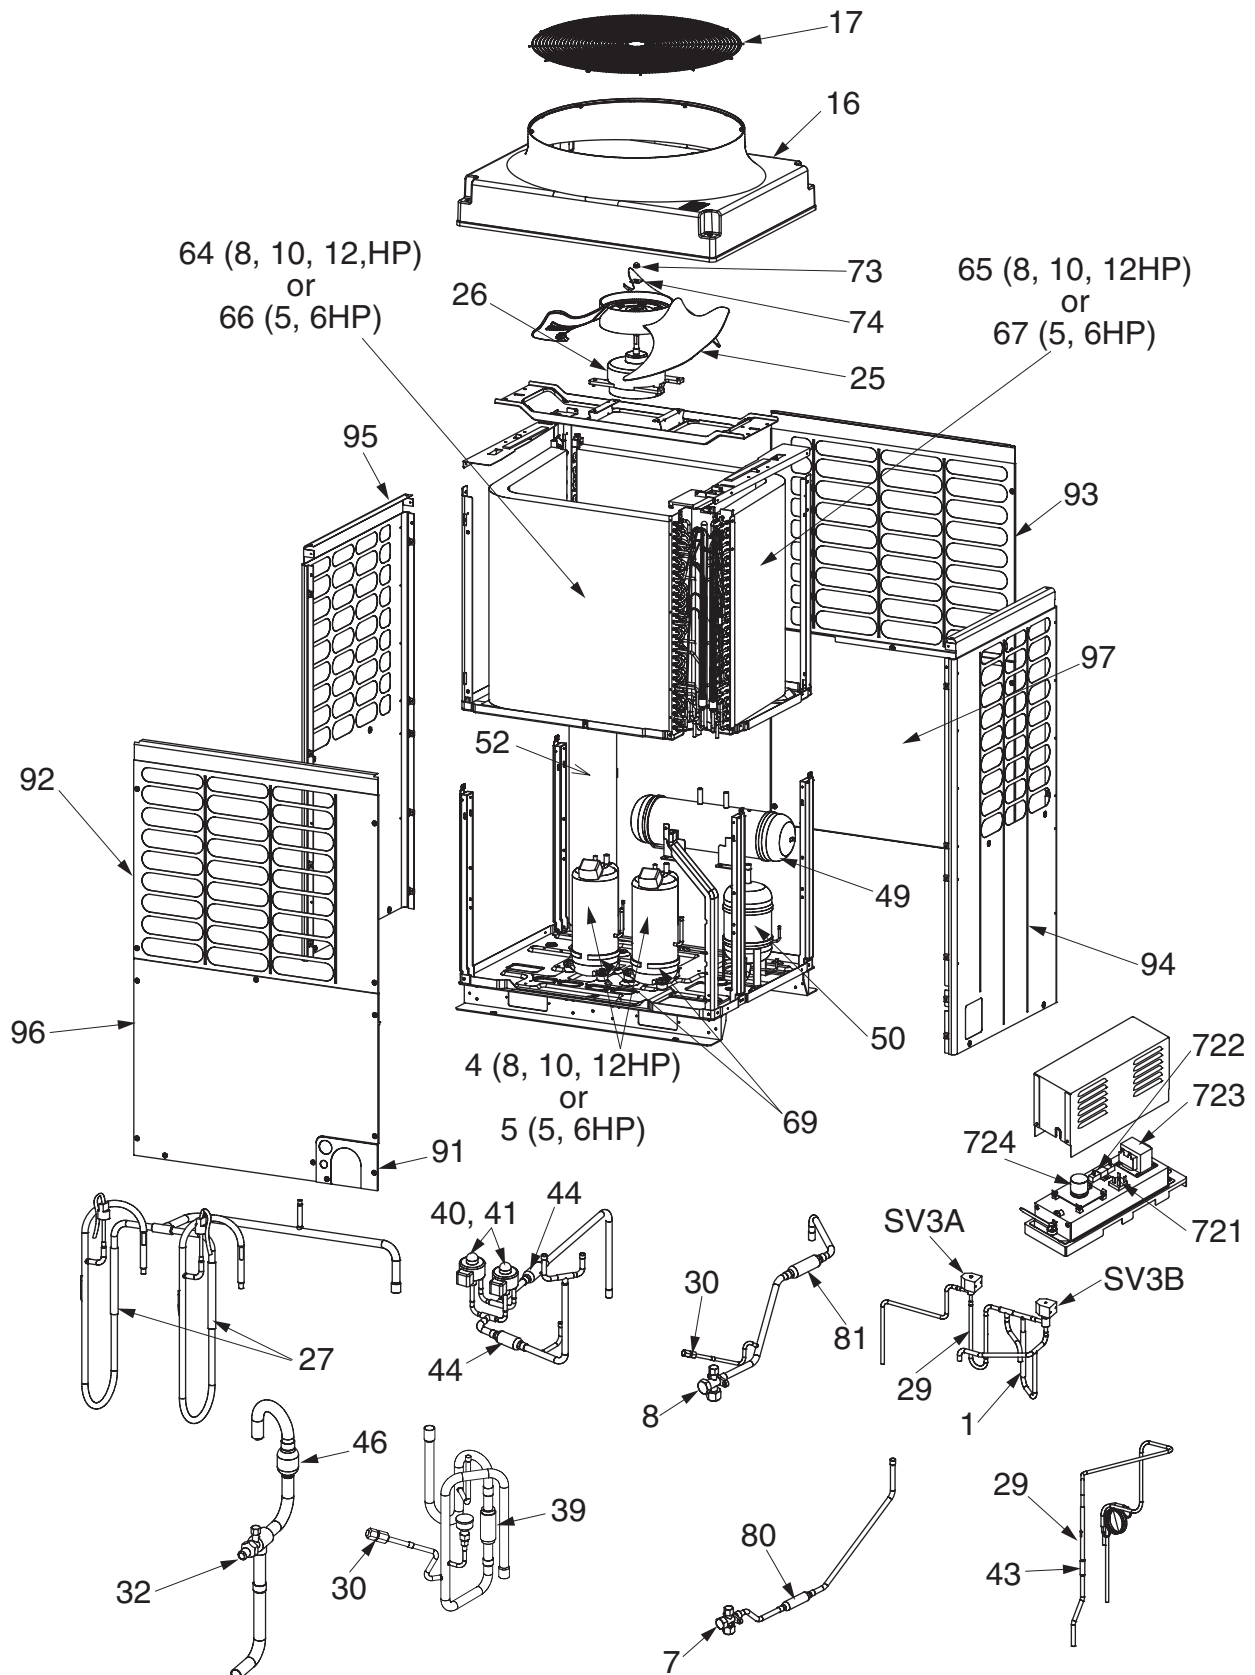

Location No.	Part No.	Description	Model Name MMY- MAP				
			1201T8-E	1001T8-E	0801T8-E	0601T8-E	0501T8-E
1	43146737	Valve, Checked, YCV5P-33GME-1	1	1	1	1	1
4	43041781	Compressor, DA421A3FB-23M	2	2	2		
5	43041782	Compressor, DA351A3FB-23M				2	2
7	43046442	Valve, Packed, 9.52 DIA	1	1	1	2	2
8	43146680	Valve, Packed, 12.7	1	1	1		
16	43100265	Cabinet, Up	1	1	1	1	1
17	43119466	Guard, Fan	1	1	1	1	1
25	43120219	Fan, Propeller, DIA 710, ASG	1	1	1	1	1
26	4312C004	Motor, Fan, DC280V, MF-230-600-1R	1	1	1	1	1
27	43146715	Valve, Checked, BCV-804DY	2	2	2	2	2
29	43146736	Valve, Checked, YCV3-22GME-1	3	3	3	3	3
30	43146676	Joint, Check	3	3	3	3	3
32	43146727	Valve, Gas, DIA 25	1	1	1		
39	43146734	Valve, Check, ZGV-S55B-A	1	1	1	1	1
40	43146709	Valve, PMV, HAM-BD24TF-1	2	2	2	1	1
41	43146708	Coil, PMV, HAM-MD12TF-3	2	2	2	1	1
43	4314Q060	Strainer, DIA 12.7, C1220T-H	2	2	2	2	2
44	4314Q056	Strainer, DIA 25.4, C1220T-H	2	2	2		
46	4314Q052	Strainer, DIA 45, C1220T-H	1	1	1		
49	43148202	Tank, Liquid	1	1	1	1	1
50	43148192	Separator	1	1	1	1	1
63	43149325	Band, Fix, SUS304	4	4	4	4	4
64	4314G264	Condenser Assembly, Three Row	1	1	1		
65	4314G265	Condenser Assembly, Three Row	1	1	1		
66	4314G249	Condenser Assembly, One Row				1	1
67	4314G250	Condenser Assembly, One Row				1	1
69	43157276	Heater, Case, 29W, AC240V	3	3	3	3	3
73	43197175	Nut, Flange, M10, SWCH12R	1	1	1	1	1
74	43197176	Washer, SPHC	1	1	1	1	1
80	4314Q055	Strainer, DIA 19.05, C1220T-H	1	1	1	1	1
81	4314Q057	Strainer, DIA 25.4, C1220T-H	1	1	1		
91	43100396	Panel, CGCD2-Z08-C77	1	1	1	1	1
92	43100406	Cabinet Assembly, Front, Up	1	1	1	1	1
93	43100407	Cabinet Assembly, Back, Up	1	1	1	1	1
94	43100408	Cabinet Assembly, Side, Left	1	1	1	1	1
95	43100409	Cabinet Assembly, Side, Right	1	1	1	1	1
96	43100410	Cabinet Assembly, Front, Down	1	1	1	1	1
97	43100411	Cabinet Assembly, Back, Down	1	1	1	1	1
721	43031110	Diode, 25A, 600V, *GBPC-2506	1	1	1	1	1
722	43155214	Resistor, 1Ω, 20W	1	1	1	1	1
723	43158207	Reactor, CH-68	1	1	1	1	1
724	4316V362	P.C. Board Assembly, Passive, MCC-1580	1	1	1	1	1


**MMY-MAP0501T8-E (5HP), MMY-MAP0601T8-E (6HP), MMY-MAP0801T8-E (8HP),
MMY-MAP1001T8-E (10HP), MMY-MAP1201T8-E (12HP)**

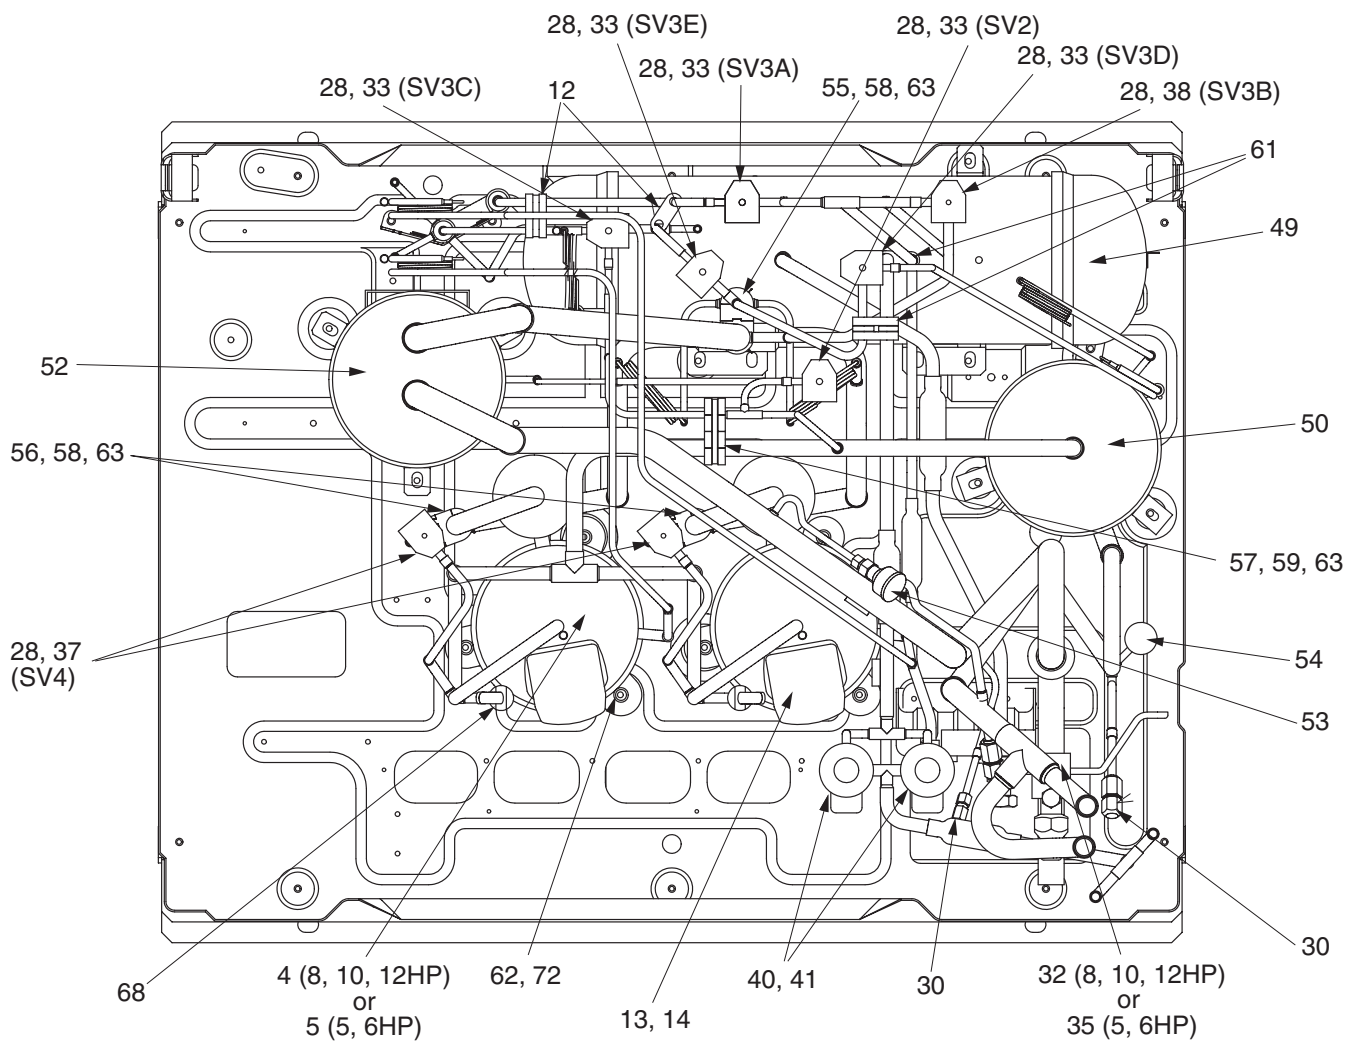

Location No.	Part No.	Description	Model Name MMY- MAP				
			1201T8-E	1001T8-E	0801T8-E	0601T8-E	0501T8-E
4	43041781	Compressor, DA421A3FB-23M	2	2	2		
5	43041782	Compressor, DA351A3FB-23M				2	2
12	43049683	Band, DIA 8, EPDM	2	2	2	1	1
13	43050407	Thermostat, Bimetal	2	2	2	2	2
14	43063317	Holder, Thermostat	2	2	2	2	2
28	43146660	Coil, Solenoid, AC220-240V, 50Hz, VPV-MOAJ510B0	7	7	7	7	7
30	43146676	Joint, Check	3	3	3	3	3
32	43146727	Valve, Gas, DIA 25	1	1	1		
33	43146711	Valve, 2-Way, VPV-122DQ1	4	4	4	4	4
35	43146699	Valve, Ball, B5/8F, Rohs				1	1
37	43146712	Valve, 2-Way, VPV-303DQ1	2	2	2	2	2
38	43146730	Valve, 2-Way, VPV-603DQ2	1	1	1	1	1
40	43146709	Valve, PMV, HAM-BD24TF-1	2	2	2	1	1
41	43146708	Coil, PMV, HAM-MD12TF-3	2	2	2	1	1
49	43148202	Tank, Liquid	1	1	1	1	1
50	43148192	Separator	1	1	1	1	1
52	43148200	Accumulator, 20L	1	1	1	1	1
53	43149377	Sensor Assembly, Low Pressure, 150XA4-L1	1	1	1	1	1
54	43149378	Sensor Assembly, High Pressure, 150XA4-H3	1	1	1	1	1
55	43149317	Rubber, Supporter, Pipe, DIA 25.4	1	1	1		
56	43149318	Rubber, Supporter, Pipe, DIA 19.0	2	2	2	3	3
57	43149319	Rubber, Supporter, Pipe, DIA 15.9	1	1	1	1	1
58	43149320	Rubber, Supporter, Pipe, DIA 8.0	3	3	3	3	3
59	43149321	Rubber, Supporter, Pipe, DIA 6.4	1	1	1	1	1
61	43149323	Rubber, Supporter, Pipe, DIA 9.52-12.7	2	2	2	2	2
62	43149324	Rubber, Cushion, EPDM	6	6	6	6	6
63	43149325	Band, Fix, SUS304	4	4	4	4	4
68	43151283	Switch, Pressure, ACB-4UB32W	2	2	2	2	2
72	43197184	Bolt, Compressor, M6, SWCH18A	6	6	6	6	6


Refrigeration Circuit Diagram

MMY-MAP0501T8-E (5HP), MMY-MAP0601T8-E (6HP), MMY-MAP0801T8-E (8HP),
MMY-MAP1001T8-E (10HP), MMY-MAP1201T8-E (12HP)

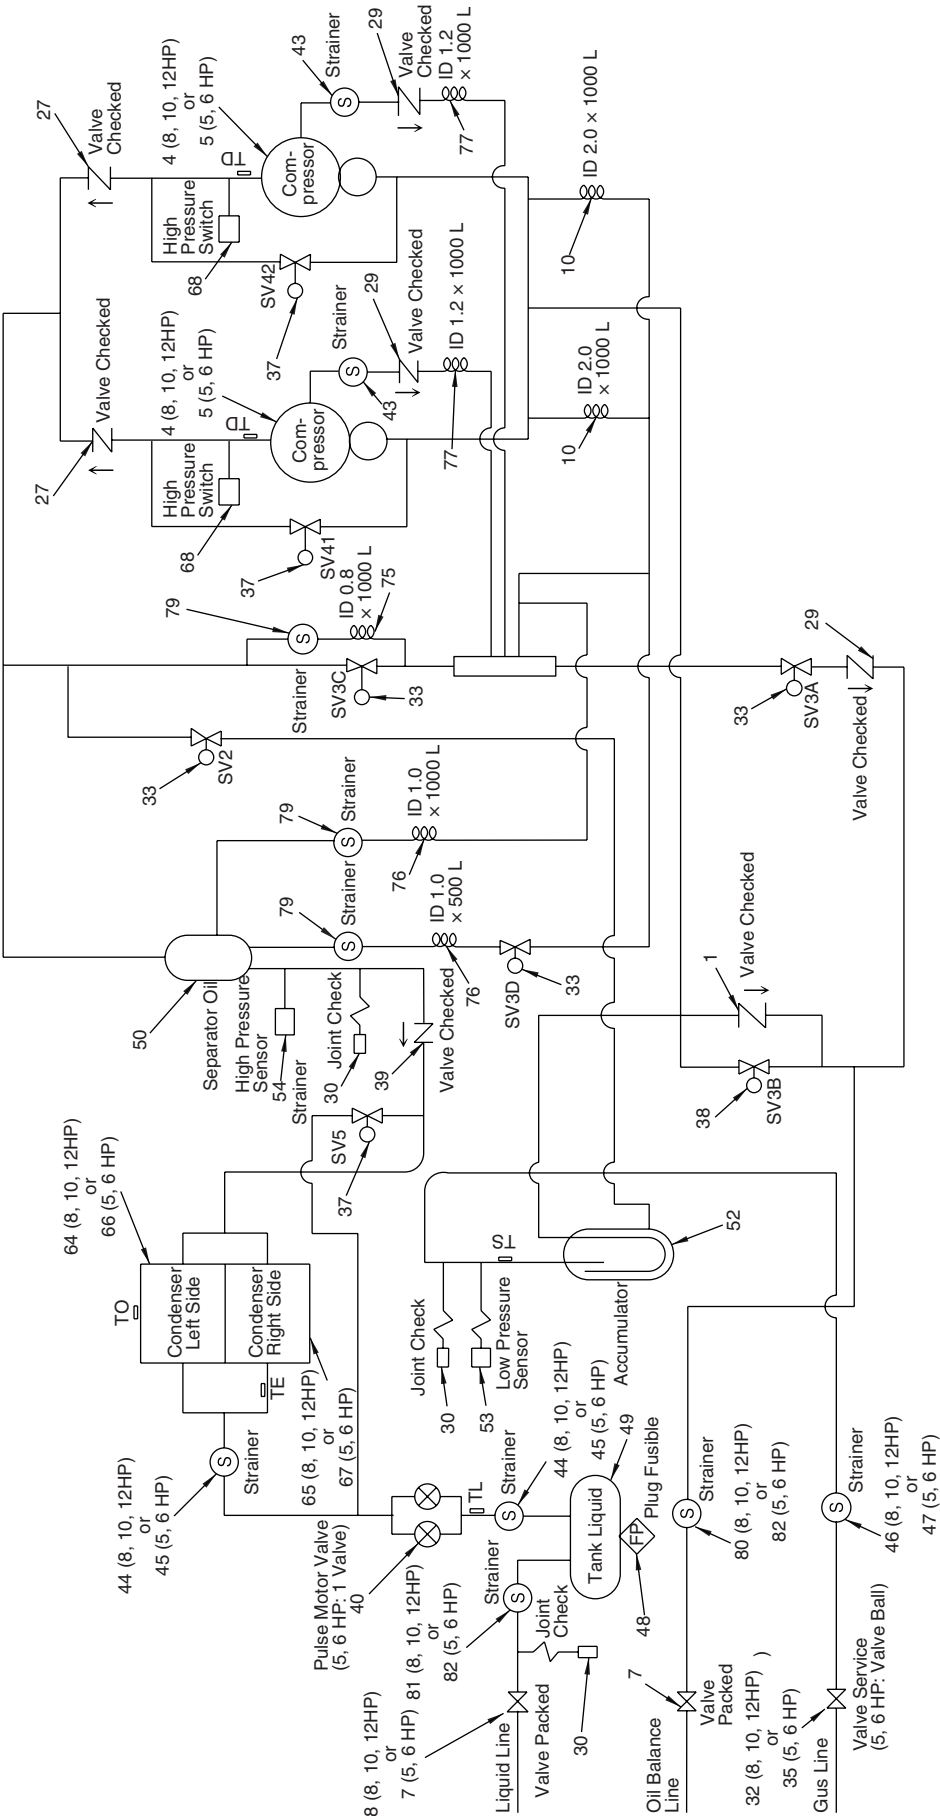

Location No.	Part No.	Description	Model Name MMY- MAP				
			1201T8-E	1001T8-E	0801T8-E	0601T8-E	0501T8-E
1	43146737	Valve, Checked, YCV5P-33GME-1	1	1	1	1	1
4	43041781	Compressor, DA421A3FB-23M	2	2	2		
5	43041782	Compressor, DA351A3FB-23M				2	2
7	43046442	Valve, Packed, 9.52 DIA	1	1	1	2	2
8	43146680	Valve, Packed, 12.7	1	1	1		
10	43047527	Tube, Capillary, ID 2.0 x 2000L	1	1	1	1	1
27	43146715	Valve, Checked, BCV-804DY	2	2	2	2	2
29	43146736	Valve, Checked, YCV3-22GME-1	3	3	3	3	3
30	43146676	Joint, Check	3	3	3	3	3
32	43146727	Valve, Gas, DIA 25	1	1	1		
33	43146711	Valve, 2-Way, VPV-122DQ1	4	4	4	4	4
35	43146699	Valve, Ball, B5/8F, Rohs				1	1
37	43146712	Valve, 2-Way, VPV-303DQ1	2	2	2	2	2
38	43146730	Valve, 2-Way, VPV-603DQ2	1	1	1	1	1
39	43146734	Valve, Checked, ZGV-S55B-A	1	1	1	1	1
40	43146709	Valve, PMV, HAM-BD24TF-1	2	2	2	1	1
43	4314Q060	Strainer, DIA 12.7, C1220T-H	2	2	2	2	2
44	4314Q056	Strainer, DIA 25.4, C1220T-H	2	2	2		
45	4314Q058	Strainer, DIA 25.4				2	2
46	4314Q052	Strainer, DIA 45, C1220T-H	1	1	1		
47	4314Q053	Strainer, DIA 21, C1220T-H				1	1
48	43148220	Plug, Fusible, 73°C	1	1	1	1	1
49	43148202	Tank, Liquid	1	1	1	1	1
50	43148192	Separator	1	1	1	1	1
52	43148200	Accumulator, 20L	1	1	1	1	1
53	43149377	Sensor Assembly, Low Pressure, 150XA4-L1	1	1	1	1	1
54	43149378	Sensor Assembly, High Pressure, 150XA4-H3	1	1	1	1	1
64	4314G264	Condenser Assembly, Three Row	1	1	1		
65	4314G265	Condenser Assembly, Three Row	1	1	1		
66	4314G249	Condenser Assembly, One Row				1	1
67	4314G250	Condenser Assembly, One Row				1	1
68	43151283	Switch, Pressure, ACB-4UB32W	2	2	2	2	2
75	44246235	Tube, Capillary, Bypass, 0.8 DIA	1	1	1	1	1
76	44246236	Tube, Capillary, Bypass, 1.0 DIA	1	1	1	1	1
77	44246239	Tube, Capillary, 1.2 DIA	1	1	1	1	1
79	4314Q054	Strainer, DIA 12.7, C1220T-H	3	3	3	3	3
80	4314Q055	Strainer, DIA 19.05, C1220T-H	1	1	1	1	1
81	4314Q057	Strainer, DIA 25.4, C1220T-H	1	1	1		
82	4314Q059	Strainer, DIA 25.4				1	1


**MMY-MAP0501T8-E (5HP), MMY-MAP0601T8-E (6HP), MMY-MAP0801T8-E (8HP),
MMY-MAP1001T8-E (10HP), MMY-MAP1201T8-E (12HP)**

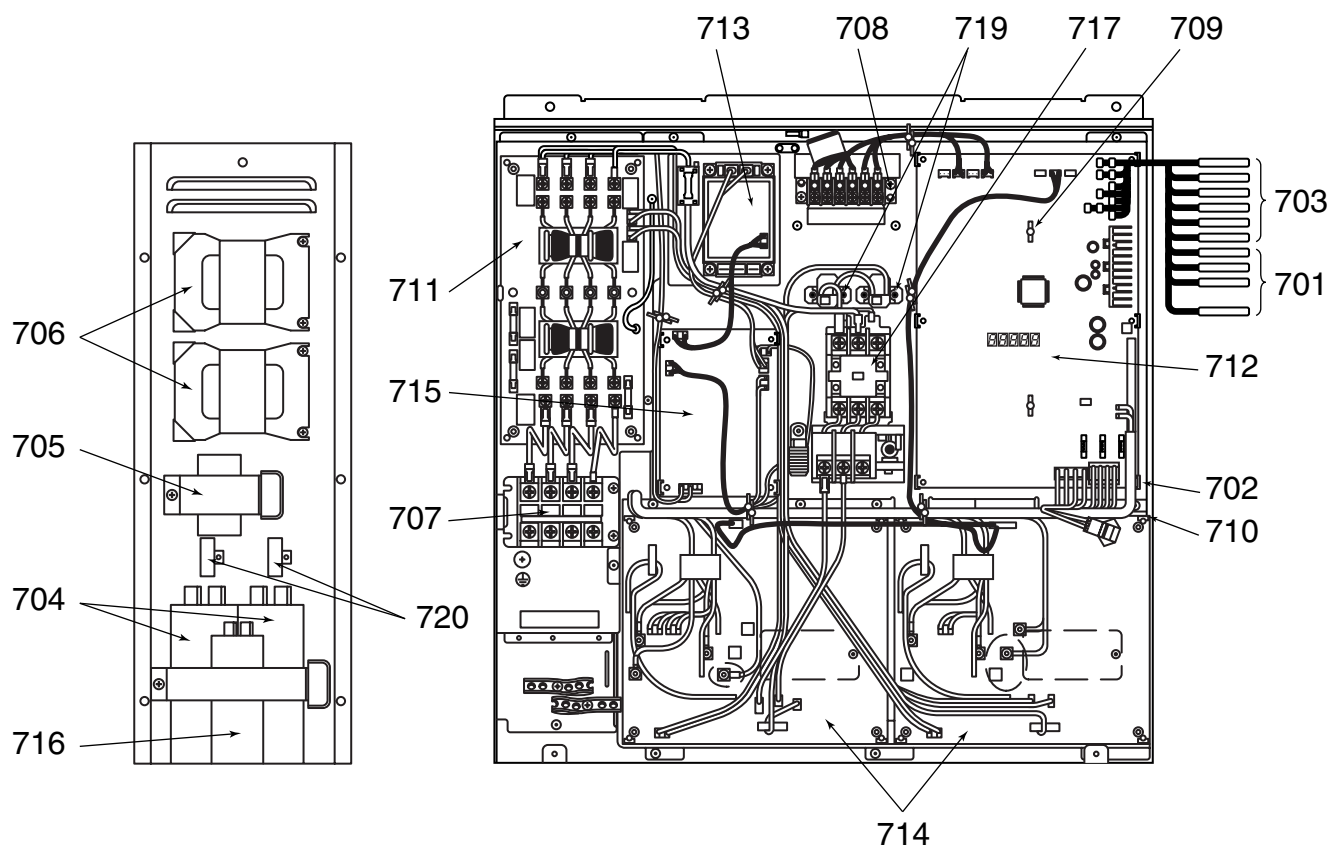

Location No.	Part No.	Description	Model Name MMY- MAP				
			1201T8-E	1001T8-E	0801T8-E	0601T8-E	0501T8-E
701	43050382	Sensor, TC (F6)	4	4	4	4	4
702	43063248	Supporter Assembly	3	3	3	3	3
703	43150315	Sensor, TD (F6)	6	6	6	6	6
704	43155176	Capacitor, 400V DC, 1500μF	2	2	2	2	2
705	43158186	Transformer, TT-01-03	1	1	1	1	1
706	43158183	Reactor, CH-44	2	2	2	2	2
707	43160559	Terminal Block, 4P, AC600V, 30A	1	1	1	1	1
708	43160548	Terminal, 6P, AC30V, 1A	1	1	1	1	1
709	43163017	Supporter	2	2	2	2	2
710	43163048	Supporter Assembly	1	1	1	1	1
711	4316V366	P.C. Board Assembly, Noise-Filter, MCC-1366	1	1	1	1	1
712	4316V263	P.C. Board Assembly, Interface, MCC-1429	1	1	1	1	1
713	4316V237	P.C. Board Assembly, Fan-IPDU, IPDU-2D16DA1	1	1	1	1	1
714	4316V245	P.C. Board Assembly, A3-IPDU, MCC-1502	2	2	2	2	2
715	4316V360	P.C. Board Assembly, Power, MCC-1439	1	1	1	1	1
716	43155194	Capacitor, 400V DC, 1000μF	1	1	1	1	1
717	43152506	Electro Magnetic Switch, FW-2S	1	1	1	1	1
719	43153006	PTC-Thermistor, ZPROYCE101A500	2	2	2	2	2
720	43155197	Resistor, 56kΩ, 15W	2	2	2	2	2


7-3. Outdoor Unit

MMY-MAP0802FT8-E, MMY-MAP1002FT8-E, MMY-MAP1202FT8-E

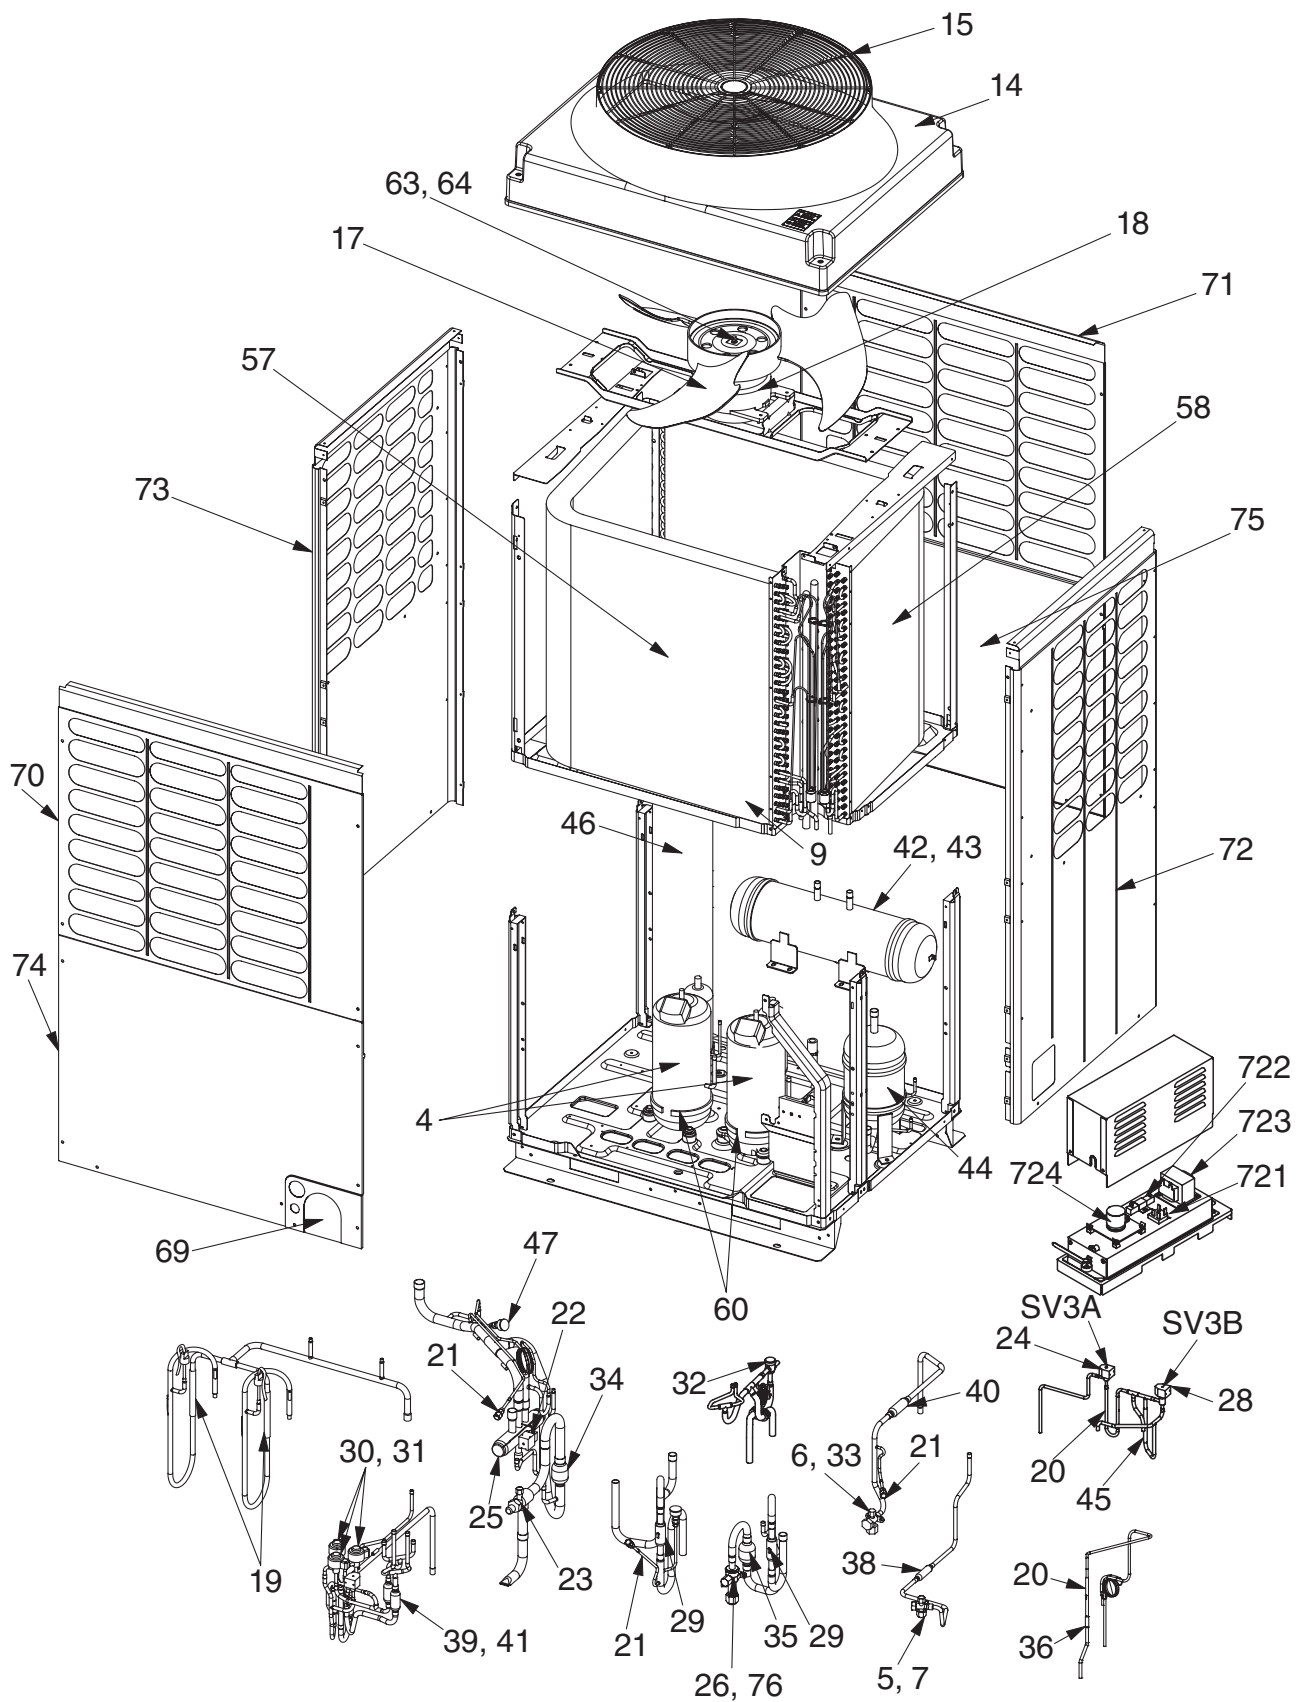

Location No.	Part No.	Description	Model Name MMY-MAP		
			1202FT8-E	1002FT8-E	0802FT8-E
4	43041781	Compressor, DA421A3FB-23M	2	2	2
5	43046442	Valve, Packed, 9.52 DIA	1	1	1
6	43146680	Valve, Packed, 12.7	1	1	1
7	43047401	Bonnet, 3/8, IN	1	1	1
9	43063332	Holder, Sensor	1	1	1
14	43100265	Cabinet, Up	1	1	1
15	43119466	Guard, Fan	1	1	1
17	43120219	Fan, Propeller, DIA 710, ASG	1	1	1
18	4312C004	Motor, Fan, DC 280V, MF-230-600-1R	1	1	1
19	43146715	Valve, Checked, BCV-804DY	2	2	2
20	43146736	Valve, Checked, YCV3-22GME-1	3	3	3
21	43146676	Joint, Check	3	3	3
22	43146722	Coil, Solenoid, STF-01AJ502E1	1	1	1
23	43146727	Valve, Gas, DIA 25	1	1	1
24	43146711	Valve, 2-Way, VPV-122DQ1	7	7	7
25	43146698	Valve, 4-Way, STF-0731G	1	1	1
26	43146699	Valve, Ball, B5/8F, Rohs	1	1	1
28	43146730	Valve, 2-Way, VPV-603DQ2	1	1	1
29	43146734	Valve, Check, ZGV-S55B-A	2	2	2
30	43146709	Valve, PMV, HAM-BD24TF-1	3	3	3
31	43146708	Coil, PMV, HAM-MD12TF-3	3	3	3
32	43146731	Valve, 2-Way, VPV-1204DQ50	1	1	1
33	43147195	Bonnet, 1/2, IN	1	1	1
34	4314Q052	Strainer, DIA 45, C1220T-H	1	1	1
35	4314Q053	Strainer, DIA 21, C1220T-H	1	1	1
36	4314Q060	Strainer, DIA 12.7, C1220T-H	2	2	2
38	4314Q055	Strainer, DIA 19.05, C1220T-H	1	1	1
39	4314Q056	Strainer, DIA 25.4, C1220T-H	2	2	2
40	4314Q057	Strainer, DIA 25.4, C1220T-H	1	1	1
41	4314Q058	Strainer, DIA 25.4	1	1	1
42	43148220	Plug, Fusible, 73°C	1	1	1
43	43148202	Tank, Liquid	1	1	1
44	43148192	Separator	1	1	1
45	43146737	Valve, Checked, YCV5P-33GME-1	1	1	1
46	43148200	Accumulator, 20L	1	1	1
47	43149377	Sensor Assembly, Low Pressure, 150XA4-L1	1	1	1
57	4314G272	Condenser Assembly, Three Row	1	1	1
58	4314G273	Condenser Assembly, Three Row	1	1	1
60	43157276	Heater, Case, 29W, AC 240V	3	3	3
61	431S8087	Owner's Manual, MMY-MAP1202FT8-E	1	1	1
63	43197175	Nut, Flange, M10, SWCH12R	1	1	1
64	43197176	Washer, SPHC	1	1	1
69	43100396	Panel, CGCD2-Z08-C77	1	1	1
70	43100406	Cabinet Assembly, Front, Up	1	1	1
71	43100407	Cabinet Assembly, Back, Up	1	1	1
72	43100408	Cabinet Assembly, Side, Left	1	1	1
73	43100409	Cabinet Assembly, Side, Right	1	1	1
74	43100410	Cabinet Assembly, Front, Down	1	1	1
75	43100411	Cabinet Assembly, Back, Down	1	1	1
76	43194029	Bonnet	1	1	1
721	43031110	Diode, 25A, 600V, *GBPC-2506	1	1	1
722	43155214	Resistor, 1Ω, 20W	1	1	1
723	43158207	Reactor, CH-68	1	1	1
724	4316V362	P.C. Board Assembly, Passive, MCC-1580	1	1	1


MMY-MAP0802FT8-E, MMY-MAP1002FT8-E, MMY-MAP1202FT8-E

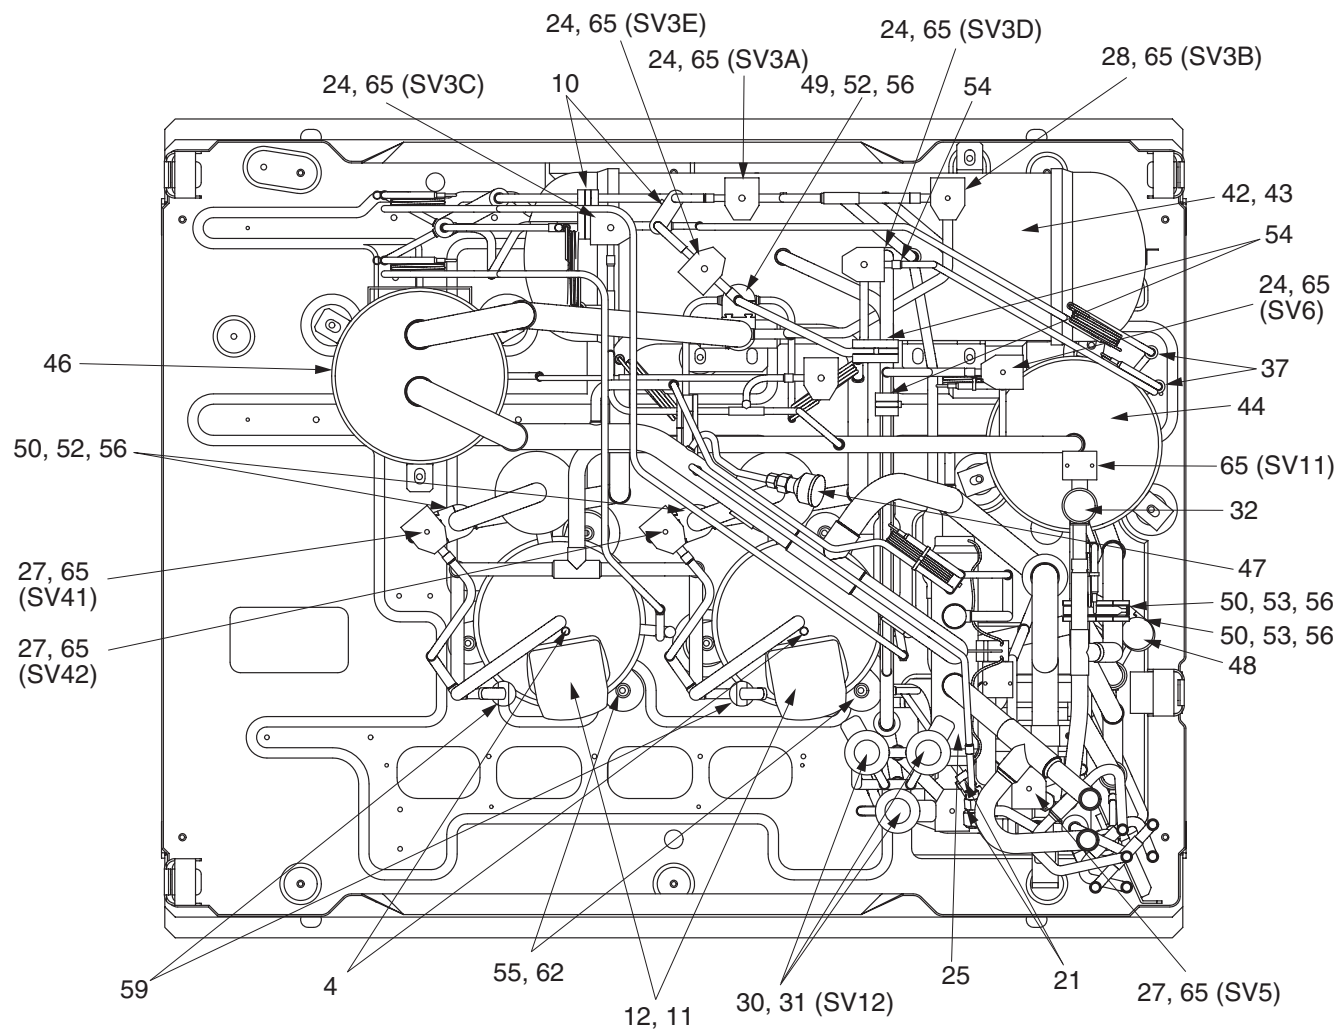

Location No.	Part No.	Description	Model Name MMY-MAP		
			1202FT8-E	1002FT8-E	0802FT8-E
4	43041781	Compressor, DA421A3FB-23M	2	2	2
10	43049683	Band, DIA 8, EPDM	2	2	2
11	43050407	Thermostat, Bimetal	2	2	2
12	43063317	Holder, Thermostat	2	2	2
21	43146676	Joint, Check	3	3	3
24	43146711	Valve, 2-Way, VPV-122DQ1	7	7	7
25	43146698	Valve, 4-Way, STF-0731G	1	1	1
27	43146712	Valve, 2-Way, VPV-303DQ1	3	3	3
28	43146730	Valve, 2-Way, VPV-603DQ2	1	1	1
30	43146709	Valve, PMV, HAM-BD24TF-1	3	3	3
31	43146708	Coil, PMV, HAM-MD12TF-3	3	3	3
32	43146731	Valve, 2-Way, VPV-1204DQ50	1	1	1
37	4314Q054	Strainer, DIA 12.7, C1220T-H	3	3	3
42	43148220	Plug, Fusible, 73°C	1	1	1
43	43148202	Tank, Liquid	1	1	1
44	43148192	Separator	1	1	1
46	43148200	Accumulator, 20L	1	1	1
47	43149377	Sensor Assembly, Low Pressure, 150XA4-L1	1	1	1
48	43149378	Sensor Assembly, High Pressure, 150XA4-H3	1	1	1
49	43149317	Rubber, Supporter, Pipe, DIA 25.4	1	1	1
50	43149318	Rubber, Supporter, Pipe, DIA 19.0	5	5	5
52	43149320	Rubber, Supporter, Pipe, DIA 8.0	3	3	3
53	43149321	Rubber, Supporter, Pipe, DIA 6.4	2	2	2
54	43149323	Rubber, Supporter, Pipe, DIA 9.52–12.7	4	4	4
55	43149324	Rubber, Cushion, EPDM	6	6	6
56	43149325	Band, Fix, SUS304	6	6	6
59	43151283	Switch, Pressure, ACB-4UB32W	2	2	2
62	43197184	Bolt, Compressor, M6, SWCH 18A	6	6	6
65	43146660	Coil, Solenoid, AV 220 – 240V, 50Hz	12	12	12


Refrigeration Circuit Diagram

MMY-MAP0802FT8-E, MMY-MAP1002FT8-E, MMY-MAP1202FT8-E

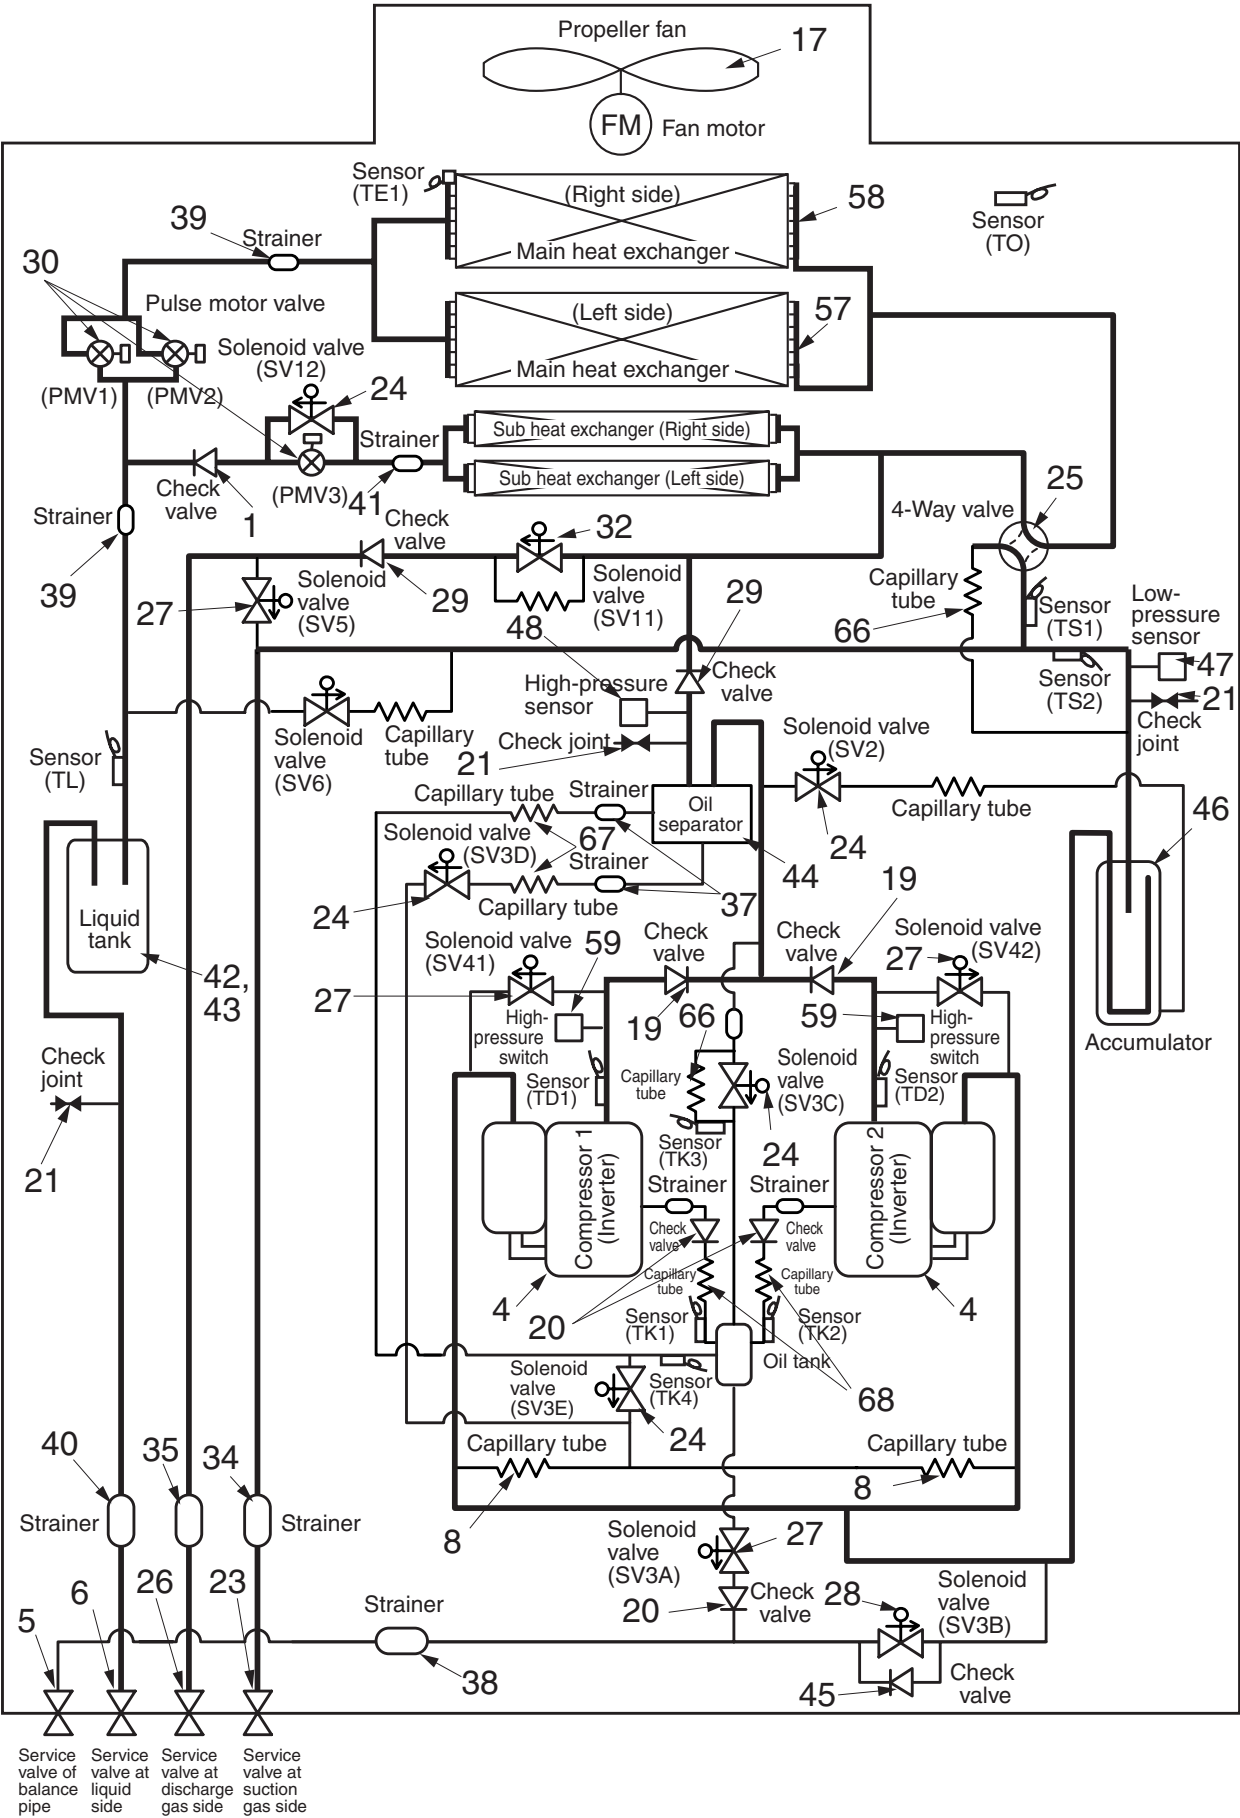

Location No.	Part No.	Description	Model Name MMY-MAP		
			1202FT8-E	1002FT8-E	0802FT8-E
1	43146721	Valve, Checked, BCV-603DY	1	1	1
4	43041781	Compressor, DA421A3FB-23M	2	2	2
5	43046442	Valve, Packed, 9.52 DIA	1	1	1
6	43146680	Valve, Packed, 12.7	1	1	1
8	43047527	Tube, Capillary, ID 2.0 x 2000L	1	1	1
17	43120219	Fan, Propeller, DIA 710, ASG	1	1	1
19	43146715	Valve, Checked, BCV-804DY	2	2	2
20	43146736	Valve, Checked, YCV3-22GME-1	3	3	3
21	43146676	Joint, Check	3	3	3
23	43146727	Valve, Gas, DIA 25	1	1	1
24	43146711	Valve, 2-Way, VPV-122DQ1	7	7	7
25	43146698	Valve, 4-Way, STF-0731G	1	1	1
26	43146699	Valve, Ball, B5/8F, Rohs	1	1	1
27	43146712	Valve, 2-Way, VPV-303DQ1	3	3	3
28	43146730	Valve, 2-Way, VPV-603DQ2	1	1	1
29	43146734	Valve, Check, ZGV-S55B-A	2	2	2
30	43146709	Valve, PMV, HAM-BD24TF-1	3	3	3
32	43146731	Valve, 2-Way, VPV-1204DQ50	1	1	1
34	4314Q052	Strainer, DIA 45, C1220T-H	1	1	1
35	4314Q053	Strainer, DIA 21, C1220T-H	1	1	1
37	4314Q054	Strainer, DIA 12.7, C1220T-H	3	3	3
38	4314Q055	Strainer, DIA 19.05, C1220T-H	1	1	1
39	4314Q056	Strainer, DIA 25.4, C1220T-H	2	2	2
40	4314Q057	Strainer, DIA 25.4, C1220T-H	1	1	1
41	4314Q058	Strainer, DIA 25.4	1	1	1
42	43148220	Plug, Fusible, 73°C	1	1	1
43	43148202	Tank, Liquid	1	1	1
44	43148192	Separator	1	1	1
45	43146737	Valve, Check, YCV5P-33GME-1	1	1	1
46	43148200	Accumulator, 20L	1	1	1
47	43149377	Sensor Assembly, Low Pressure, 150XA4-L1	1	1	1
48	43149378	Sensor Assembly, High Pressure, 150XA4-H3	1	1	1
57	4314G272	Condenser Assembly, Three Row	1	1	1
58	4314G273	Condenser Assembly, Three Row	1	1	1
59	43151283	Switch, Pressure, ACB-4UB32W	2	2	2
66	44246235	Tube, Capillary, Bypass, 0.8 DIA	1	1	1
67	44246236	Tube, Capillary, Bypass, 1.0 DIA	1	1	1
68	44246239	Tube, Capillary, Bypass, 1.2 DIA	1	1	1

MMY-MAP0802FT8-E, MMY-MAP1002FT8-E, MMY-MAP1202FT8-E

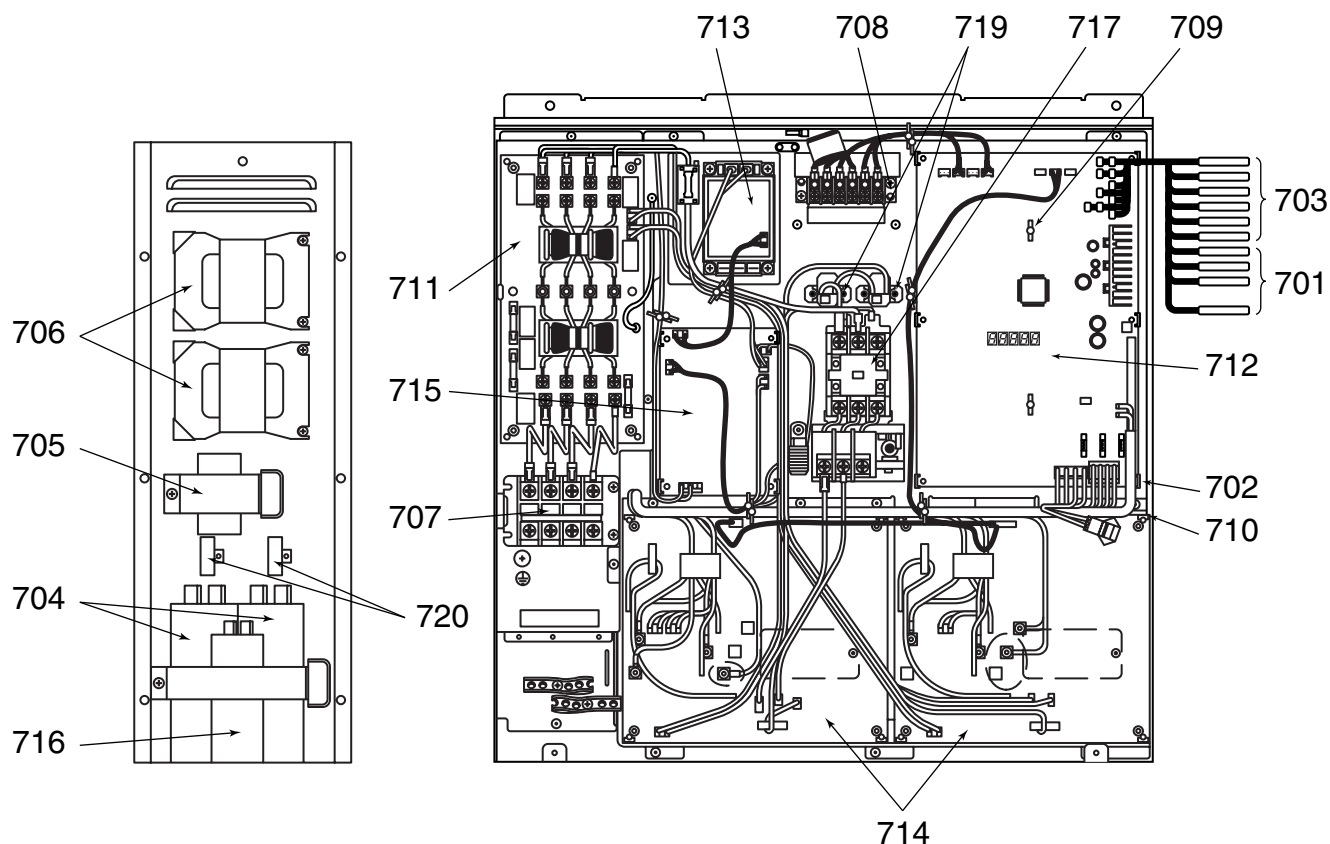

Location No.	Part No.	Description	Model Name MMY-MAP		
			1202FT8-E	1002FT8-E	0802FT8-E
701	43050382	Sensor, TC (F6)	5	5	5
702	43063248	Supporter Assembly	3	3	3
703	43150315	Sensor, TD (F6)	6	6	6
704	43155176	Capacitor, 400V DC, 1500 μ F	2	2	2
705	43158186	Transformer, TT-01-03	1	1	1
706	43158183	Reactor, CH-44	2	2	2
707	43160559	Terminal Block, 4P, AC 600V, 30A	1	1	1
708	43160548	Terminal, 6P, AC 30V, 1A	1	1	1
709	43163017	Supporter	2	2	2
710	43163048	Supporter Assembly	1	1	1
711	4316V366	P.C. Board Assembly, Noise-Filter, MCC-1366	1	1	1
712	4316V263	P.C. Board Assembly, Interface, MCC-1429	1	1	1
713	4316V237	P.C. Board Assembly, Fan-IPDU, IPDU-2D16DA1	1	1	1
714	4316V245	P.C. Board Assembly, A3-IPDU, MCC-1502	2	2	2
715	4316V360	P.C. Board Assembly, Power, MCC-1439	1	1	1
716	43155194	Capacitor, 400V DC, 1000 μ F	1	1	1
717	43152506	Electro Magnetic Switch, FW-2S	1	1	1
719	43153006	PTC-Thermistor, ZPROYCE101A500	2	2	2
720	43155197	Resistor, 56k Ω , 15W	2	2	2

TOSHIBA CARRIER CORPORATION

23-17, TAKANAWA 3 CHOME, MINATOKU, TOKYO, 108-0074, JAPAN

Copyright © 1999 to 2005 TOSHIBA CARRIER CORPORATION, ALL Rights Reserved.